

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)


Document no.	Work description	
D2013/80870	Rescuing victims from situations involving live Low Voltage (LV) equipment at ground level.	
	<p>Scope</p> <p>This SWI is mandatory for working on or near live LV electrical equipment for the supply or distribution of electricity or for work on live LV electrical installations; subject to conditions specified below in the "Overview" section.</p> <p>This SWI is NOT for rescue of victims from situations involving High Voltage.</p> <p>This SWI excludes special procedures that apply to the rescue of victims from height.</p> <p>This SWI includes the requirements for the inspection, use and care of rescue kits.</p>	
Review date	References	
26/02/2022	<ul style="list-style-type: none"> AS 2225 – 1994 (incl. A1) Insulating gloves for electrical purposes ENA National guideline for management of tools and equipment used in the electricity supply industry (October 2009) Guide to the Training of Personnel Working on or near Electricity Works (October 1999) ISSC14 "Guide to Electrical Workers' Safety Equipment" (January 1993 & October 2010) ISSC 24 "Guide to Electricity Workers' Escape & Rescue Procedures" 1997, Electricity Association of NSW. (Document has been withdrawn but this reference is left as it was referred to in producing version 1.1 of the SWI) SMS-06-GD-0268 Working around Electrical Equipment PR D 78701 Personnel Certifications - Electrical D2013/80869 Electric Shock Protocol Work Health and Safety Regulation 2017 	
PPE and precautions	Competencies or qualifications	Licences or permits required
As described in the document	Authorised electrical workers as described in PR D 78701 Personnel Certifications - Electrical	--
Tools and equipment required		
As described below		

Overview	<p>This SWI is mandatory for working on live LV electrical equipment for the supply or distribution of electricity</p> <p>This SWI is mandatory for working near live LV electrical equipment for the supply or distribution of electricity, unless the risk assessment shows that there is no serious risk associated with the proposed work</p> <p>This SWI is mandatory for work on live LV electrical installations, unless the work consists only of testing and the risk assessment shows that there is no serious risk of contact with exposed electrical equipment associated with the proposed work. In such cases of testing, a Safety Observer would not be required and thus not available to enact rescue.</p> <p>Factors to be considered during a risk assessment include but are not be limited to:</p> <ul style="list-style-type: none"> the area where the electrical work is to be carried out is clear of obstructions so as to allow for easy access and exit, the point at which the electrical equipment can be disconnected or isolated from its electricity supply is: <ul style="list-style-type: none"> clearly marked or labelled, and clear of obstructions so as to allow for easy access and exit by the worker who is to carry out the electrical work or any other competent person, and capable of being operated quickly, only persons authorised can enter the immediate area in which electrical work on energised electrical equipment is being carried out, complexity of the electrical work, proximity to live exposed conductors or equipment, work environment, number of persons working as a team, and tools and equipment (including personal protective equipment) used.
-----------------	--


Principles and priorities	<p>Rescue procedures cannot be defined in detail for all cases. However, everyone who works on or near LV electrical equipment, and those assisting in such work, are to be familiar with the basic principles outlined in this SWI.</p> <p>In situations involving electric shock, give priority to the prompt release and rescue of a victim as time is essential for the victim's survival.</p>
----------------------------------	--

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)

Employee competence	<p>Authorised Electrical workers are to undergo training, instruction and assessment in the rescue procedures at intervals not exceeding 12 months. Line Managers are to make sure that records of this training are kept. Where it is determined during work planning activities that a person who has been assessed as competent to undertake this rescue is required, the field supervisors are to make sure they are present during live low voltage works.</p>
----------------------------	---

Rescuer's safety	<p>At all times rescuers are to fully assess the situation they are facing and not jeopardise their own safety by any action they may take, despite the consequences this might have for any victim.</p> <p>All personnel undertaking the rescue are to wear the appropriate personal protective equipment (PPE); that is, at a minimum the insulating gloves contained within the rescue kit. It is anticipated that the rescuer would be an electrically trained person and as such, already be wearing the PPE as required by <i>SMS-06-GD-0268 Working around Electrical Equipment</i> Clause 5.3.6 Personal Protective Equipment.</p> <hr/> <p style="text-align: center;"> Note Take care that the rescuer does not become a casualty!</p>
-------------------------	--

Release from live electrical equipment	<p>Contact with live electrical equipment can result in the worker becoming the victim of electric shock. The recommended steps to be taken for the release and rescue are detailed in the Rescue steps section and summarised in the flowchart (Figure 2).</p>
---	--

Rescue Kit	<p>The rescue kit is contain the following items (as shown in Figure 1):</p> <ol style="list-style-type: none"> torch emergency isolation tag low voltage retrieval aid (insulated crook) trauma dressing rescue kit bag fire blanket insulated gloves list of contents (not shown in the photo) <p>Missing contents shall be replaced as required.</p> <div style="text-align: center;">  </div> <p style="text-align: center;">Figure 1 Rescue Kit Items</p>
-------------------	---

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)

**Rescue Kit
(cont.)**



Note

Rescue equipment shall not be used for any purpose other than its intended use, and their components shall not be altered in any way that may affect their operation as originally recommended or supplied.

**Inspection
and Testing
of Rescue kit**

Before Use Inspection:

Before commencing the proposed electrical work, check the rescue kit to make sure all items are in good condition:

- torch functioning properly,
- trauma dressing is sealed and within use by date,
- insulating gloves shall be visually inspected for cuts, tears, perishing and distortion,
- insulating gloves shall be tested for any air leakage as illustrated below,



Step 1. Hold Glove Downward and Grasp Cuff.






Step 2. Twirl Glove Towards Your Body to Trap Air Inside. Squeeze Glove To Look For Damage.



Step 3. Hold Glove To Face and Feel. Listen For Escaping Air or Immerse In Water and Watch For Bubbles.

- check the insulated crook and bag for any sign of damage or deterioration,
- using your hands located at each end of the insulated crook, apply an “opposing twist” to apply a torsional tension through the length of the insulated crook a means of verifying structural integrity.

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)

Inspection and Testing of Rescue kit (cont.)	<p>Routine Inspection and Tests:</p> <p>On an annual basis the integrity of the Rescue Kit shall be verified to ensure components of the kit are still fit for the purpose intended.</p> <p>In addition, to the 'Before Use Inspection' requirements detailed above the:</p> <ul style="list-style-type: none"> • storage of the Rescue Kit and in particular the LV insulating gloves is to be verified as in compliance with Appendix C of AS 2225. and • insulating crook, which is rated for 5 kV shall be subjected to an insulation resistance test. Upon application of an insulation resistance test of 1 kV DC for 1 minute, the measured resistance value is not to be less than 50 M Ohm. 																		
Planning for rescue from live LV	<p>The rescue kit is to be readily available prior to work being performed on or near live low voltage equipment.</p> <p>The rescue kit is to be:</p> <ul style="list-style-type: none"> • inspected as per the 'Before Use Inspection' requirements detailed above, and • arranged so that items, particularly the insulated gloves and crook, are readily available. <p>Install the emergency isolation tag at the isolation switch before starting the work as described in the "Scope" of this SWI.</p>																		
General precautions for rescue	<table border="1"> <tr> <td data-bbox="304 844 359 994">1</td> <td data-bbox="363 844 1479 994"> <p>Quickly observe the general circumstances, noting:</p> <ul style="list-style-type: none"> • the voltage that is involved and if it is LV. This rescue technique does NOT apply if the voltage is High Voltage, • if there are special difficulties involved, and • if special precautions are necessary. </td> </tr> <tr> <td data-bbox="304 1001 359 1070">2</td> <td data-bbox="363 1001 1479 1070"> <p>Act promptly: Time is important and delay may be fatal; but speed of action shall be accompanied by due care.</p> </td> </tr> <tr> <td data-bbox="304 1077 359 1178">3</td> <td data-bbox="363 1077 1479 1178"> <p>Take precautions against receiving a shock yourself: Remember that until the victim is released or the electricity has been isolated, the victim is electrified at the voltage of the live electrical equipment.</p> </td> </tr> <tr> <td data-bbox="304 1184 359 1330">4</td> <td data-bbox="363 1184 1479 1330"> <p>Where practicable, isolate the electricity to prevent further electric shock(s). If the electrical equipment contacted by the victim is controlled by a switch, which is readily accessible, the switch should be immediately opened to facilitate the rescue. LOOK for the "emergency isolation tag".</p> <p>This is subject to the rescuer being competent to do so. The equipment involved shall still be treated as alive unless isolated and proved dead.</p> </td> </tr> </table>	1	<p>Quickly observe the general circumstances, noting:</p> <ul style="list-style-type: none"> • the voltage that is involved and if it is LV. This rescue technique does NOT apply if the voltage is High Voltage, • if there are special difficulties involved, and • if special precautions are necessary. 	2	<p>Act promptly: Time is important and delay may be fatal; but speed of action shall be accompanied by due care.</p>	3	<p>Take precautions against receiving a shock yourself: Remember that until the victim is released or the electricity has been isolated, the victim is electrified at the voltage of the live electrical equipment.</p>	4	<p>Where practicable, isolate the electricity to prevent further electric shock(s). If the electrical equipment contacted by the victim is controlled by a switch, which is readily accessible, the switch should be immediately opened to facilitate the rescue. LOOK for the "emergency isolation tag".</p> <p>This is subject to the rescuer being competent to do so. The equipment involved shall still be treated as alive unless isolated and proved dead.</p>										
1	<p>Quickly observe the general circumstances, noting:</p> <ul style="list-style-type: none"> • the voltage that is involved and if it is LV. This rescue technique does NOT apply if the voltage is High Voltage, • if there are special difficulties involved, and • if special precautions are necessary. 																		
2	<p>Act promptly: Time is important and delay may be fatal; but speed of action shall be accompanied by due care.</p>																		
3	<p>Take precautions against receiving a shock yourself: Remember that until the victim is released or the electricity has been isolated, the victim is electrified at the voltage of the live electrical equipment.</p>																		
4	<p>Where practicable, isolate the electricity to prevent further electric shock(s). If the electrical equipment contacted by the victim is controlled by a switch, which is readily accessible, the switch should be immediately opened to facilitate the rescue. LOOK for the "emergency isolation tag".</p> <p>This is subject to the rescuer being competent to do so. The equipment involved shall still be treated as alive unless isolated and proved dead.</p>																		
Key considerations	<p>The key considerations for situations involving low voltage are that:</p> <ul style="list-style-type: none"> • the minimum safe approach distance for live LV conductors or equipment is 500mm for authorised electrical persons • the use of LV insulating gloves is mandatory as it provides electric shock protection to the hand of the rescuer. This is enhanced by the use of the insulated LV retrieval aid (the insulated crook) which provides additional insulation and allows extra clearances to be maintained. 																		
Rescue steps	<p>Follow these general steps in rescue from live LV equipment:</p> <table border="1"> <tr> <td data-bbox="304 1568 359 1682">1</td> <td data-bbox="363 1568 1479 1682"> <p>Seek help – if practicable, and if this can be done without delay e.g. verbal request to bystanders, contact Infrastructure Control (ICON) on 1800 060 015 or (02) 9379 4911 or internal no. 94911.</p> </td> </tr> <tr> <td data-bbox="304 1688 359 1713">2</td> <td data-bbox="363 1688 1479 1713"> <p>Assess the situation.</p> </td> </tr> <tr> <td data-bbox="304 1720 359 1756">3</td> <td data-bbox="363 1720 1479 1756"> <p>Isolate the electricity. LOOK for the "emergency isolation tag".</p> </td> </tr> <tr> <td colspan="2" data-bbox="304 1762 1479 1877"> <p> Note If the isolation switch is far away from the incident site, or the rescuer is unable to 'isolate' safely skip this step and continue with preceding steps being aware that the exposed equipment and victim are still electrically LIVE.</p> </td> </tr> <tr> <td data-bbox="304 1883 359 1919">4</td> <td data-bbox="363 1883 1479 1919"> <p>Put on the insulating gloves.</p> </td> </tr> <tr> <td data-bbox="304 1926 359 1951">5</td> <td data-bbox="363 1926 1479 1951"> <p>Grab the insulated crook.</p> </td> </tr> <tr> <td data-bbox="304 1957 359 1982">6</td> <td data-bbox="363 1957 1479 1982"> <p>Check for danger such as live parts, live cables and the potential to cause a short circuit.</p> </td> </tr> <tr> <td data-bbox="304 1989 359 2024">7</td> <td data-bbox="363 1989 1479 2024"> <p>Approaching from behind the victim, place the insulated crook under the victim's shoulder.</p> </td> </tr> <tr> <td data-bbox="304 2031 359 2080">8</td> <td data-bbox="363 2031 1479 2080"> <p>Turn the insulated crook into the victim's body. When pulling the victim clear, the insulated crook can slide off if it is not turned into their body and just placed under their arm.</p> </td> </tr> </table>	1	<p>Seek help – if practicable, and if this can be done without delay e.g. verbal request to bystanders, contact Infrastructure Control (ICON) on 1800 060 015 or (02) 9379 4911 or internal no. 94911.</p>	2	<p>Assess the situation.</p>	3	<p>Isolate the electricity. LOOK for the "emergency isolation tag".</p>	<p> Note If the isolation switch is far away from the incident site, or the rescuer is unable to 'isolate' safely skip this step and continue with preceding steps being aware that the exposed equipment and victim are still electrically LIVE.</p>		4	<p>Put on the insulating gloves.</p>	5	<p>Grab the insulated crook.</p>	6	<p>Check for danger such as live parts, live cables and the potential to cause a short circuit.</p>	7	<p>Approaching from behind the victim, place the insulated crook under the victim's shoulder.</p>	8	<p>Turn the insulated crook into the victim's body. When pulling the victim clear, the insulated crook can slide off if it is not turned into their body and just placed under their arm.</p>
1	<p>Seek help – if practicable, and if this can be done without delay e.g. verbal request to bystanders, contact Infrastructure Control (ICON) on 1800 060 015 or (02) 9379 4911 or internal no. 94911.</p>																		
2	<p>Assess the situation.</p>																		
3	<p>Isolate the electricity. LOOK for the "emergency isolation tag".</p>																		
<p> Note If the isolation switch is far away from the incident site, or the rescuer is unable to 'isolate' safely skip this step and continue with preceding steps being aware that the exposed equipment and victim are still electrically LIVE.</p>																			
4	<p>Put on the insulating gloves.</p>																		
5	<p>Grab the insulated crook.</p>																		
6	<p>Check for danger such as live parts, live cables and the potential to cause a short circuit.</p>																		
7	<p>Approaching from behind the victim, place the insulated crook under the victim's shoulder.</p>																		
8	<p>Turn the insulated crook into the victim's body. When pulling the victim clear, the insulated crook can slide off if it is not turned into their body and just placed under their arm.</p>																		

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)


Rescue steps (cont.)	9	<p>Pull the victim clear of the 'live' exposed electrical equipment.</p> <p>As the victim falls, stand clear as they may push you towards the 'live' exposed electrical equipment. If possible support the victim's head as they are positioned to a safe position.</p>
	10	<p>Seek urgent medical attention.</p> <p>Immediately call Infrastructure Control (ICON) on 1800 060 015 or (02) 9379 4911 or internal no. 94911.</p> <p>Upon ICON answering the phone you should:</p> <ul style="list-style-type: none"> • first say "Emergency, Emergency, Emergency". <p>Then state:</p> <ul style="list-style-type: none"> • Identification and location, • The nature of the emergency, and • The type of assistance required. <p>In some situations such as when access to the rail corridor will not be required by emergency services and/or removal of the electrical supply will not require ICON to coordinate such activities, it may be preferable to contact the emergency services first, in such cases, call 000 (or 112 from a mobile phone) for an ambulance and, if necessary, rescue services.</p>
	11	<p>Make safe the incident scene.</p> <p>The incident scene is not to be left unattended until it has been made safe. ICON can assist in organising this.</p>
	12	<p>First Aid.</p> <p>Persons trained in first aid should follow first aid steps DRSABCD (Danger, Response, Send for Help, Airway, Breathing, Circulation and Defibrillation). Others should follow the instructions given by the ambulance call line operator.</p> <p>Consideration may also need to be given to significant trauma such as cervical spine injury.</p> <p>Treat burns.</p>
	13	<p>Ambulance transport to hospital.</p> <p>The injured person(s) shall be transported to the nearest hospital,</p> <p>The injured person(s) is not to be left alone or allowed to drive to the hospital as heart problems can occur up to several hours following an electric shock.</p> <p>In the first preference, the injured person(s) shall be transported by ambulance. Should ambulance transport not be possible a Team Leader, next senior work party member, or Line Manager shall arrange:</p> <ul style="list-style-type: none"> • for alternative transport e.g. taxi or vehicle & driver, and • to have another person, where possible a qualified first aider and preferably one knowing the details of the incident, to: <ul style="list-style-type: none"> - accompany the injured person(s) in the alternative transport to the nearest hospital, and - wait until all tests are completed.
14	<p>Complete subsequent steps regarding:</p> <ul style="list-style-type: none"> • Initial treatment, • After assessment, • Continuing treatment, • Incident reporting, and • Statutory notification <p>as detailed in <i>D2013/80869 Electric Shock Protocol</i>.</p>	

Additional controls

NIL

{Remainder of page left intentionally blank.}

Rescue from Live Low Voltage Equipment (Including Rescue Kit Care)

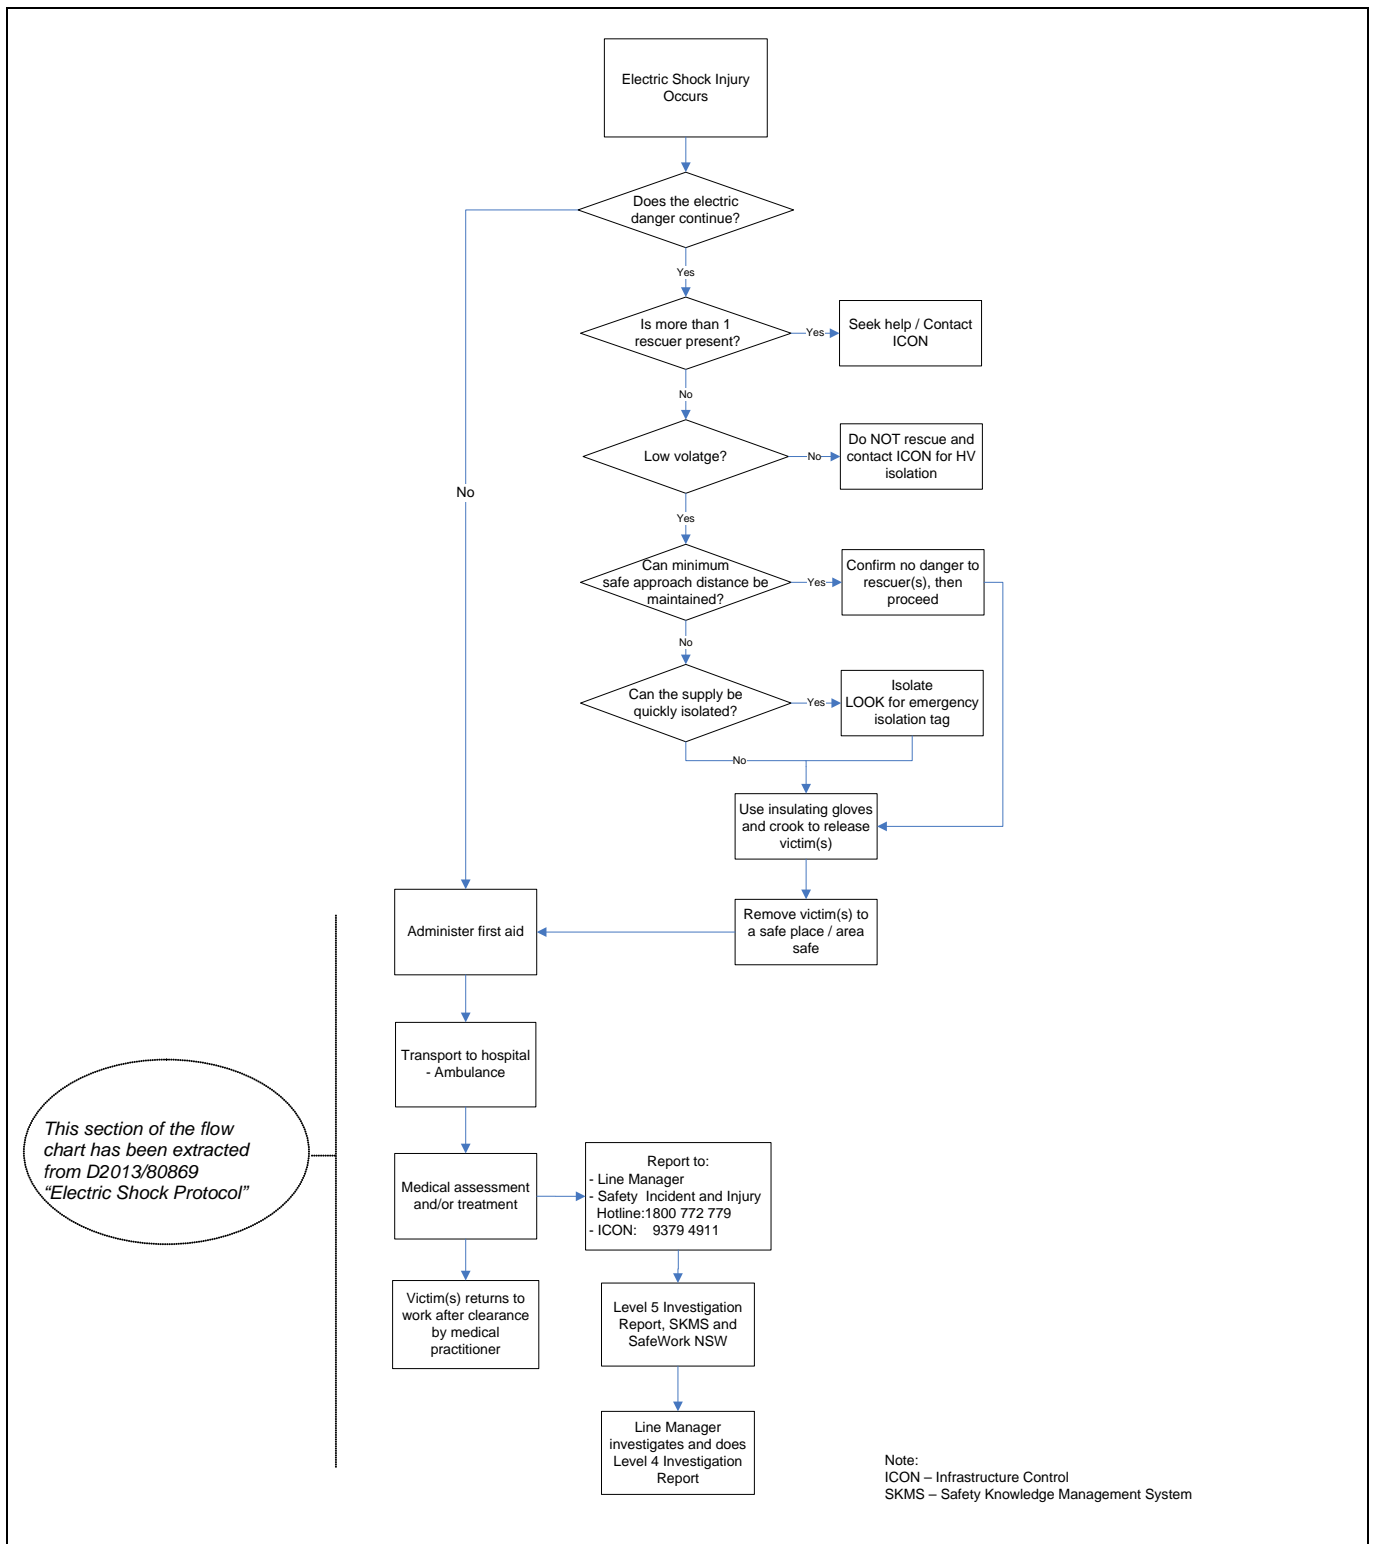

This section of the flow chart has been extracted from D2013/80869 "Electric Shock Protocol"

Note:
ICON – Infrastructure Control
SKMS – Safety Knowledge Management System

Figure 2 Release and rescue procedure in the event of a live LV electrical accident

Note: Persons should read and understand the details contained in this Safe Work Instruction. Do not just rely on referring to this flow chart.