

Engineering System Integrity
Electrical Network Safety Rules

Engineering Specification
Electrical Distribution Unit

Electrical Distribution Network Management

SP D 79047

**Earthing of High Voltage
Equipment using Portable
Earthing Equipment**

Version 1.0

Date in Force: 1 February 2022

Approved by: Associate Director
Electrical Distribution Unit
Engineering System Integrity

Authorised by: Engineering Technical
Publications Manager
System Integrity

Disclaimer

This document was prepared for use by persons in connection with works near or on/within the rail network electricity system operated by Sydney Trains. Sydney Trains makes no warranties, express or implied, that compliance with the contents of this document shall be sufficient to ensure safe systems or work or operation. It is the document user's sole responsibility to ensure that the copy of the document it is viewing is the current version of the document as in use by Sydney Trains. To the extent permitted by law, Sydney Trains excludes any and all liability for any loss or damage, however caused (including through negligence), which may be directly or indirectly suffered in connection with the use of this document.

Copyright

The information in this document is protected by copyright and no part of this document may be reproduced, altered, stored or transmitted by any person without the prior consent of Sydney Trains.

Document control

Version	Date	Author/ Prin. Eng.	Summary of change
1.0	1 February 2022	ENSR Project Team	First issue as Sydney Trains document. Previously assigned PR D 78204 V1.2. Reviewed as part of the ENSR Project.

Document history (previously PR D 78204)

Version	Date	Author/ Prin. Eng.	Summary of change
1.0	18 August 2015	Chris Leung	First issue as a Sydney Trains document, rebranded from previous RailCorp SMS-06-EN-0563 V1.1
1.1	14 August 2018	Chris Leung	3 Yearly review – no technical changes
1.2	19 February 2019	Nick Loveday	Updated PR D 78204 "Approved by" to Associate Director Electrical Distribution Unit

Table of Contents

1	Purpose and Scope	4
2	Definitions	4
3	General Requirements	4
4	Hazards	4
5	High Voltage Aerial Lines Outside Substations	5
5.1	Earthing Equipment.....	5
5.2	Application of Portable Earths.....	5
5.2.1	Establish an earth	5
5.2.2	Connect the Earthing Set to the earth	7
5.2.3	Prove dead	7
5.2.4	Earth the conductors.....	8
5.3	Earthing One Circuit on a Pole Carrying Multiple Circuits	10
5.4	Earthing Multiple Circuits	12
5.5	Aerial Earth Wires	13
5.6	Bare Down Leads.....	14
5.7	Breaking of Earthed Conductors	15
5.8	Raising or lowering of aerial conductors	15
5.9	Areas Subject to Induced Voltages or an Increased Risk of Lightning Strikes.....	15
5.10	Removal of Portable Earths	16
6	High Voltage Underground Cables to Aerial Equipment	17
6.1	Cable earthing from Pole A to Pole B	17
6.2	Cable earthing from Pole to substation.....	18
7	Equipotential Bonding for Work on Conductive Poles/Structures	18
8	Exposed High Voltage Outdoor Busbars at Substations	19
8.1	Earthing Equipment.....	19
8.2	Earthing Procedure	19
8.3	Removal of Earths.....	20
8.4	Connection to High Busbars	20
9	Reference documents	22
Appendix A	Overhead Line Series Connected Earthing Equipment	23
Appendix B	Overhead Line Star Connected Earthing Equipment	24
Appendix C	Portable Bonding Equipment	25

1 Purpose and Scope

This document describes the procedure for the earthing of High Voltage electrical equipment in the field using portable earthing equipment, including the use of portable earthing sets in substations. It covers:

- a. equipment to be used
- b. process for installation and removal of portable earths
- c. hazards related to the use of portable earthing equipment and techniques to control the associated risks.

2 Definitions

Refer to the **Electrical Safety Definitions** page available on the **RailSafe** site.

3 General Requirements

Prior to performing any of the earthing procedures covered by this document, all relevant procedures shall be followed. Relevant procedures are identified in *RL D 79800 Electrical Network Safety Rules*.

NOTE

The diagrams shown in this document are guides only and each situation shall be individually assessed.

4 Hazards

The procedure outlined in this document shall be strictly followed to avoid the possibility of burns, other physical injury or electric shock whilst applying portable earths.

Appropriate personal protective equipment, including hard hats, shall be worn whilst connecting and disconnecting portable earthing equipment to reduce the risk of injury due to falling equipment.

A person using portable earthing equipment could be at risk of cutting their hand or have a protruding glass fibre penetrating the skin of the hand. An initial inspection of the operating stick shall be conducted to identify any such conditions prior to it being further handled. Working gloves shall be worn whilst working with portable earths.

To avoid the hazard of possible electric shock during the application of portable earthing equipment, the steps as described in Section 5.2 shall be strictly adhered to.

5 High Voltage Aerial Lines Outside Substations

5.1 Earthing Equipment

The earthing equipment consists of:

- a. an earth spike
- b. flexible insulated cable fitted with a conductor clamp for connection to the earth spike or permanent earth when available
- c. insulated stick(s).

Earthing sets for aerial lines are either connected in a series or star configuration. Appendix A and Appendix B show the standard arrangements for the series and star connected earthing sets respectively. The series and star connected earthing equipment shall meet the requirements of *SP D 79033 Requirements for Portable Earthing Equipment for the High Voltage System*.

Care shall be taken to ensure that the Earthing Equipment is rated for the fault level/clearing time at the location where it is to be applied.

If a set of portable earthing equipment has been subjected to fault current, the earthing set shall be immediately replaced by a set with a rated current/rated time classification not less than the set being replaced. The faulted set shall be withdrawn from service, and all current carrying components, excluding the earth spike, shall be destroyed and disposed of in accordance with Sydney Trains procedure *NMD-NOM-PR-433 Minor Plant Equipment Procedure*.

5.2 Application of Portable Earths

Pre-use inspection of earthing set in accordance with *SP D 79043 Inspection and Care of Portable Earthing Equipment for the High Voltage System* shall be carried out prior to the application of portable earths.

The procedure for the application of portable earths shall be carried out strictly in the following order:

5.2.1 Establish an earth

If a suitable permanent earth is present, check for continuity and connect the earth end of the flexible cable to the permanent earth as close as possible to the pole base concrete or structure footing.

If a suitable permanent earth is unavailable, an earth connection is to be made to an earth spike driven at least **600 mm** into the ground, as illustrated in Figure 1.

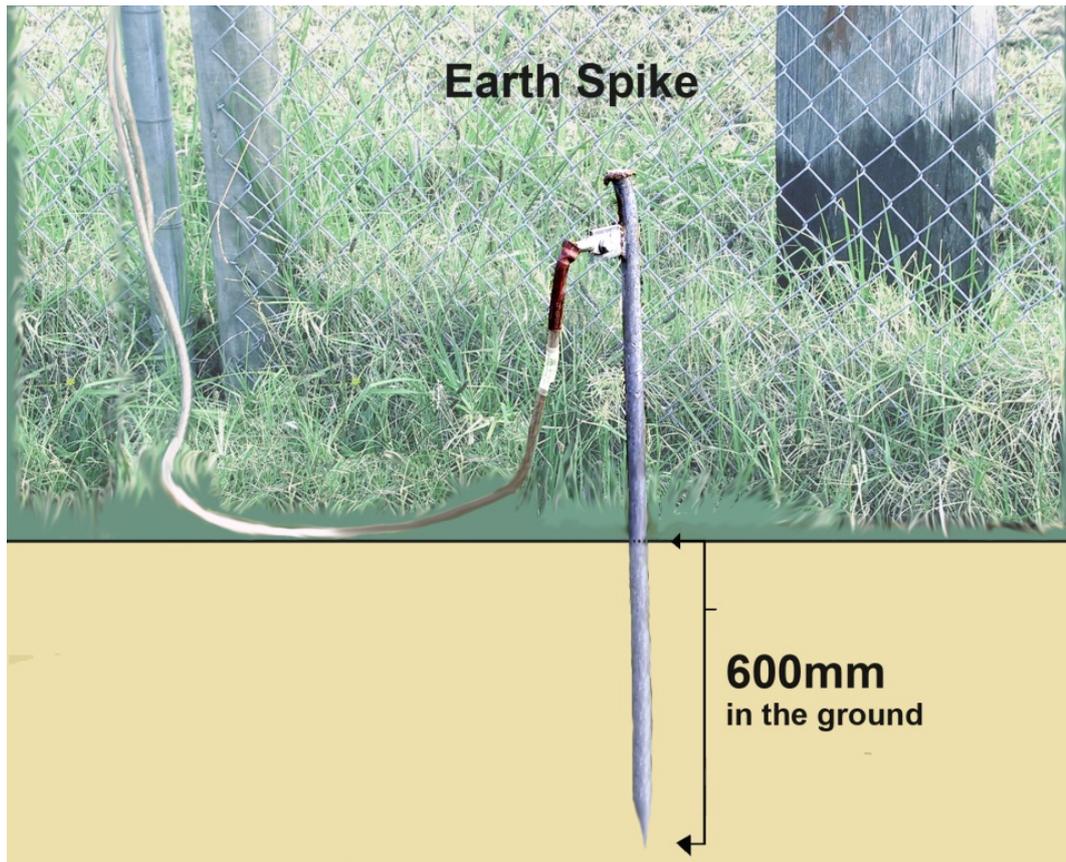


Figure 1: Earth spike driven into the ground

WARNING

Connection to earth via a permanent earth is the preferred method. If an earth spike is to be used in conjunction with the permanent earth for whatever reason (e.g. the integrity of the permanent earth is in doubt), the two shall be bonded together before applying the portable earths (Refer to Section 5.6).

When driving the temporary earth spike, care shall be taken to avoid striking any underground assets. It is preferred that an assets search be completed in the area where the earth spike is to be driven. The search should be undertaken in accordance with the *SMS-06-GD-3144 Guide to Excavations and Earthworks*.

WARNING

Under emergency conditions, it may not be possible to complete an underground assets search. In this case, a detailed search of the surrounding area for signs of underground assets is critical.

Notwithstanding the results of underground assets searches, inspect the locality of the site for evidence of underground assets such as marker pegs, pits, conduits going into the ground from poles, fire hydrants, etc. No work should be undertaken until any discrepancy between the features evident on site and the search results have been resolved.

The final location for the earth spike should be clear of any discovered assets and:

- a. as close as possible to the pole base concrete or structure footing but not more than 1 metre away if practical
- b. on the opposite side of the pole to any cables/services running down the pole
- c. within the alignment of the conductors above, preferably on the opposite side to the placement of any ladders.

Seek advice from the Line Manager or ICON Electrical if the above requirements cannot be met.

If an underground asset is struck, follow the instructions set out in SMS-06-GD-3144. In addition, you should report all workplace incidents (accidents and near misses) to your Line Manager and to the Safety Incident and Injury Hotline on phone: 1800 772 779.

5.2.2 Connect the Earthing Set to the earth

Connect the earthing set conductor to the permanent earth or temporary earth spike already driven into the ground.

5.2.3 Prove dead

Ensure that the aerial conductors are proven de-energized with a High Voltage detector in accordance with *PR D 78203 High Voltage Operating Procedure*, example Figure 2.



Figure 2: Testing with High Voltage detector

5.2.4 Earth the conductors

WARNING

Connection to any conductors SHALL NOT be made until the earth end of the bridging conductor has been bonded to the common earth.

WARNING

Aerial conductors to be bonded to earth shall be proved dead prior to connection of any earthing equipment.

Prior to commencing application, arrange the earthing set in an accessible position, e.g. park heads on the pole step first.

Elevate the insulated operating stick and connect the conductor clamp to each aerial conductor in turn, ensuring that connection is made to the nearest aerial conductor first. As illustrated in Figure 3 the middle conductor is the nearest conductor in this case. This allows all further earthing connections to be subsequently made in a safe manner.



Figure 3: Application of earths

Connection to an aerial conductor shall be made by drawing the hooked section of the conductor clamp firmly and smartly onto the aerial conductor. Then, if screw-type earth clamps are used, tighten the connection clamp by rotating the insulated stick in a clockwise direction (Figure 4).

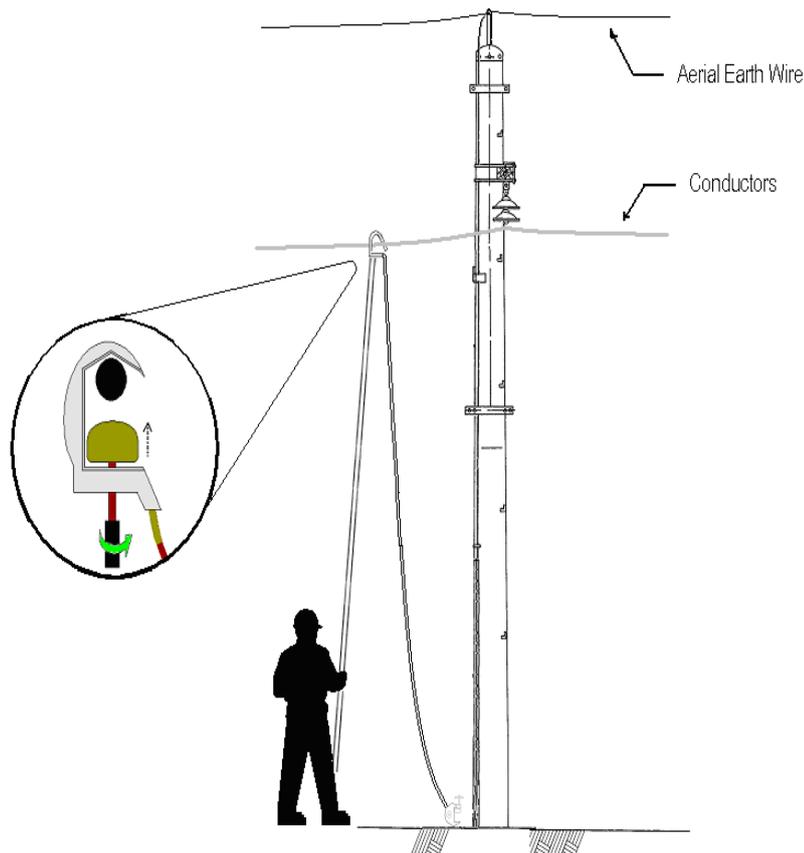


Figure 4: Attaching to aerial conductors using portable earths

NOTE

Figure 4 is for illustration purposes only, the use of an elevated work platform or climbing devices may be required to connect the earths to aerial conductors.

During the procedure, only the ends of the operating sticks away from the conductor clamps are to be handled. Additionally, the person applying the earths shall ensure that the earthing equipment does not come within the minimum Safe Approach Distances (SADs) of any live conductor or Exposed Equipment, including Low Voltage and communications circuits; as set out in *SP D 79049 Safe Approach Distances (SADs)*.

The person applying the earths shall maintain the minimum SADs set out in *SP D 79049* from the conductors to which the earths have not yet been applied.

An example of earthed aerial conductors is shown on Figure 5.



Figure 5: Earthed aerial conductors

5.3 Earthing One Circuit on a Pole Carrying Multiple Circuits

When earthing the lower circuit at a pole carrying multiple vertically spaced circuit lines and the upper circuit is live, a dangerous potential could exist between earth and the pole at the height of the lower circuit.

An additional earth connection clamp shall be applied to a pole band or a pole step at or above the height of the lower circuit before a person bridges the pole and the earthed conductors (Figure 6).

This hazard does not exist if a bare earthing "down wire" has been installed on the pole.

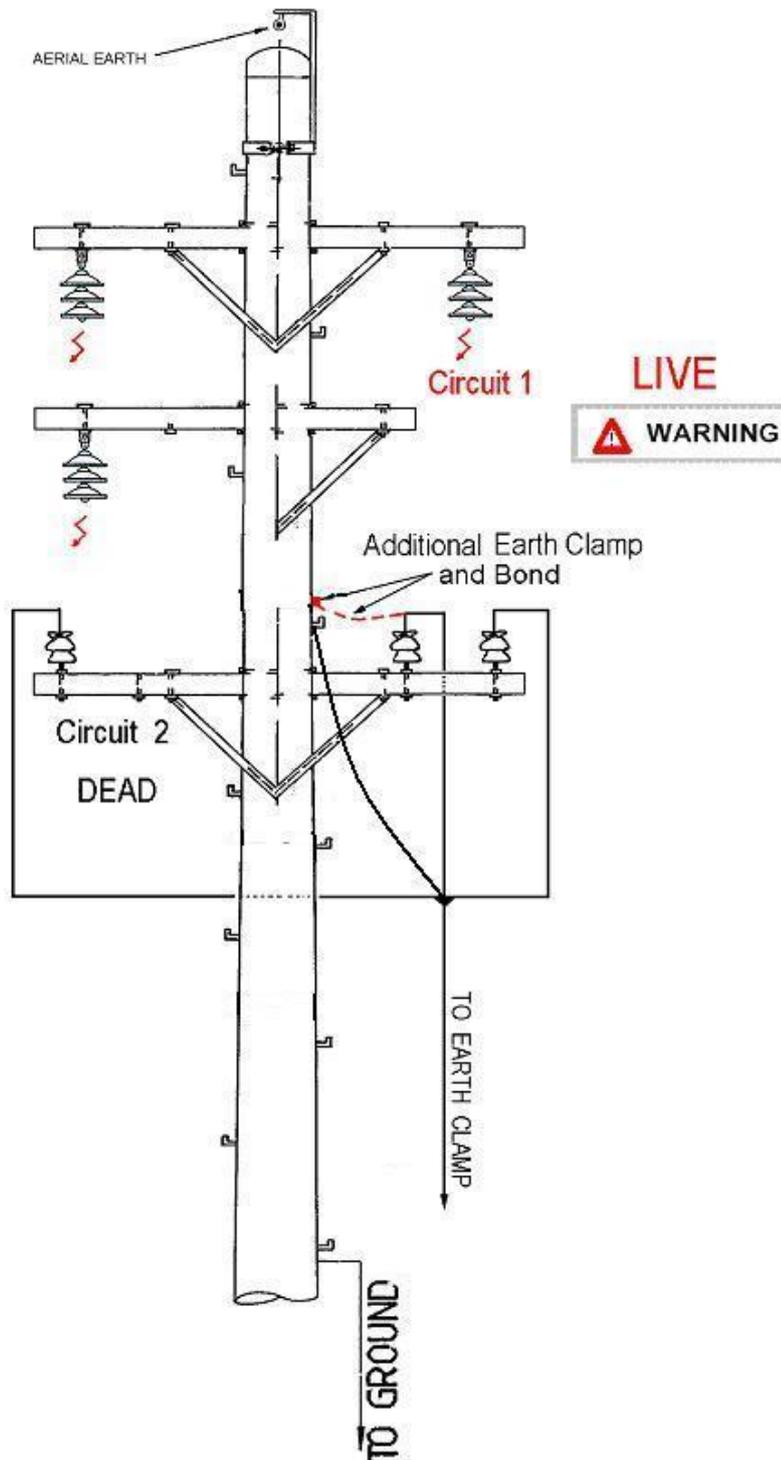


Figure 6: Earthing vertically spaced multiple circuit poles with one circuit live

All earthed conductors at the worksite shall be connected to a common earth to ensure equipotential conditions.

5.4 Earthing Multiple Circuits

Where earths are applied to multiple circuits at a work location, they shall be connected to either a common earth spike or alternatively their individual earth spikes shall be connected together onto an equipotential bond (Figure 7).

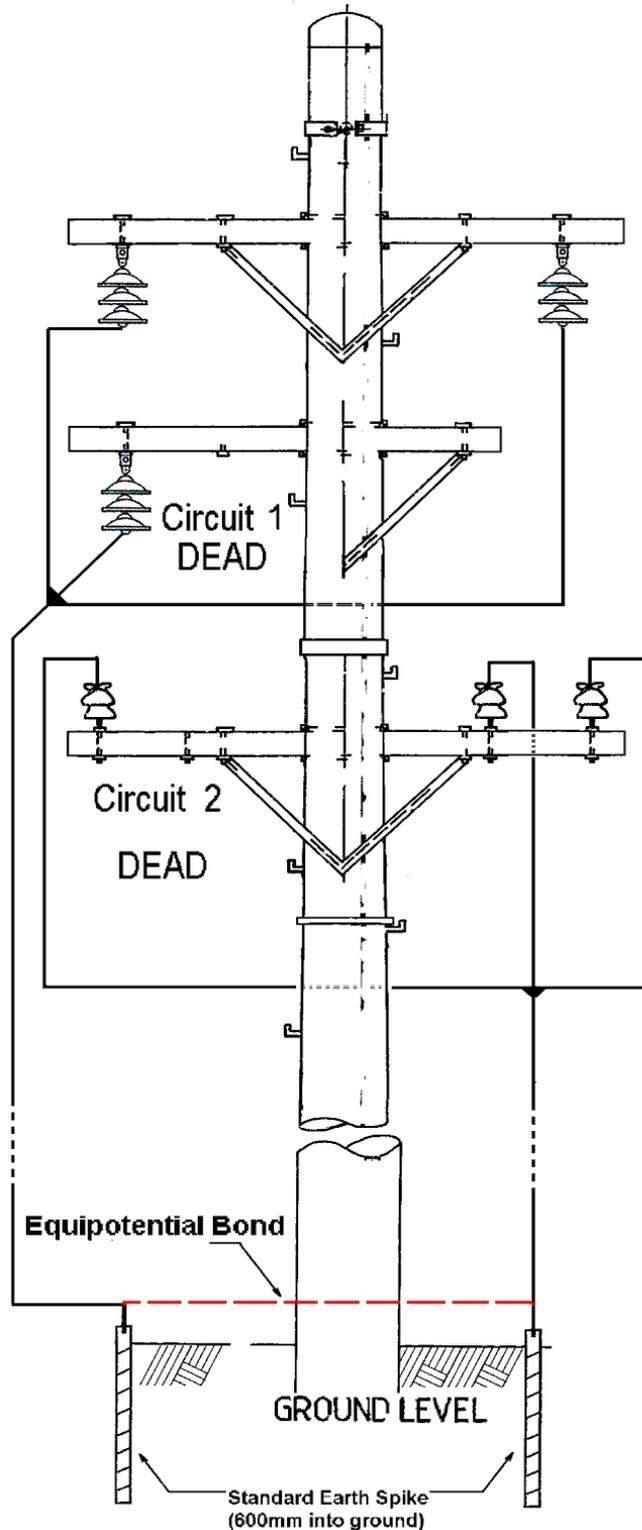


Figure 7: Earthing multiple circuits at a work location

5.5 Aerial Earth Wires

At locations where aerial earth wires are present, the aerial earth wire shall be bonded together with the other earthed conductors (Figure 8).

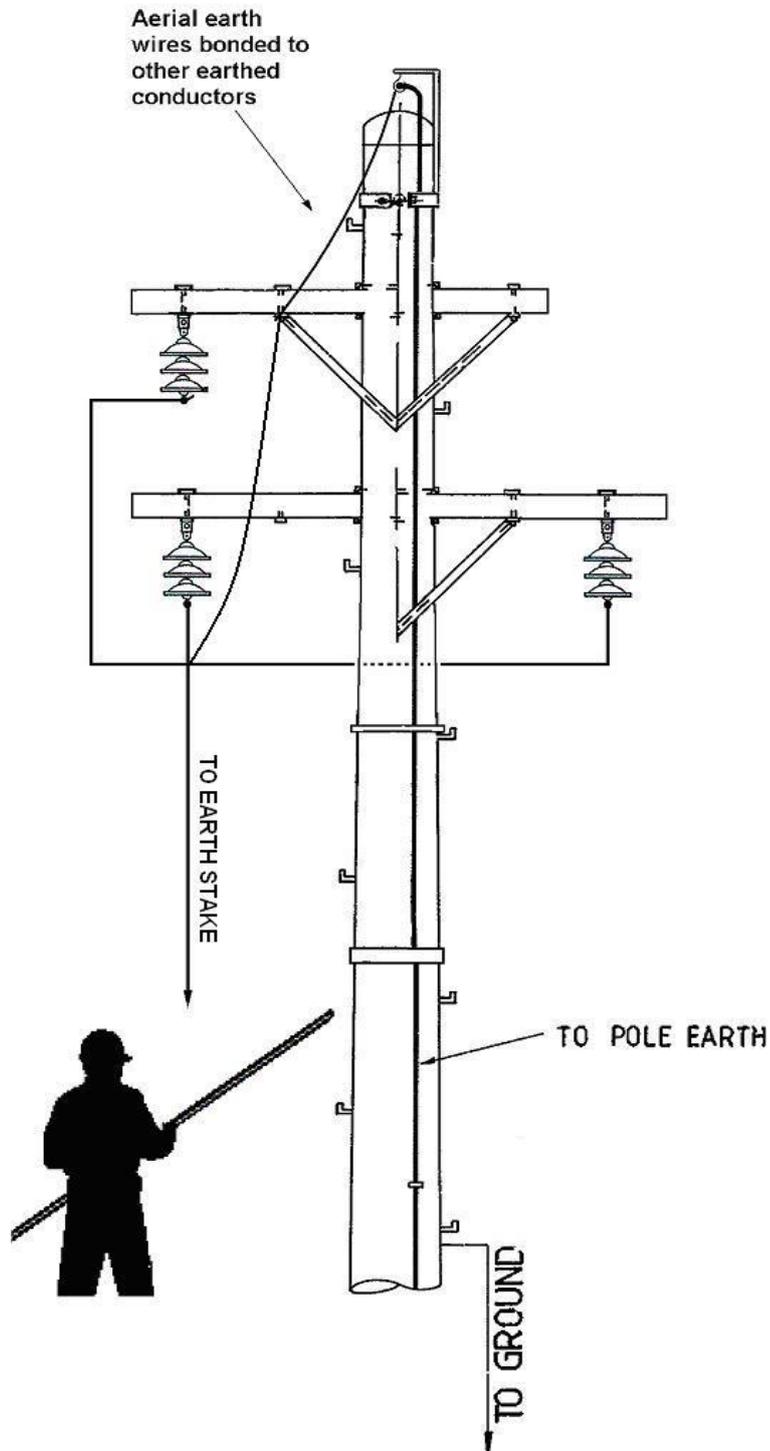


Figure 8: Earthing on a pole with an aerial earth wire

5.6 Bare Down Leads

If there is a bare down lead present on the pole and a driven earth spike is also to be used, then the down lead and the earth spike shall be bonded together at ground level **before** any earthing equipment is attached to the earth spike.

For ease of installation, the connection to the down lead may be made above the cover board (Figure 9).

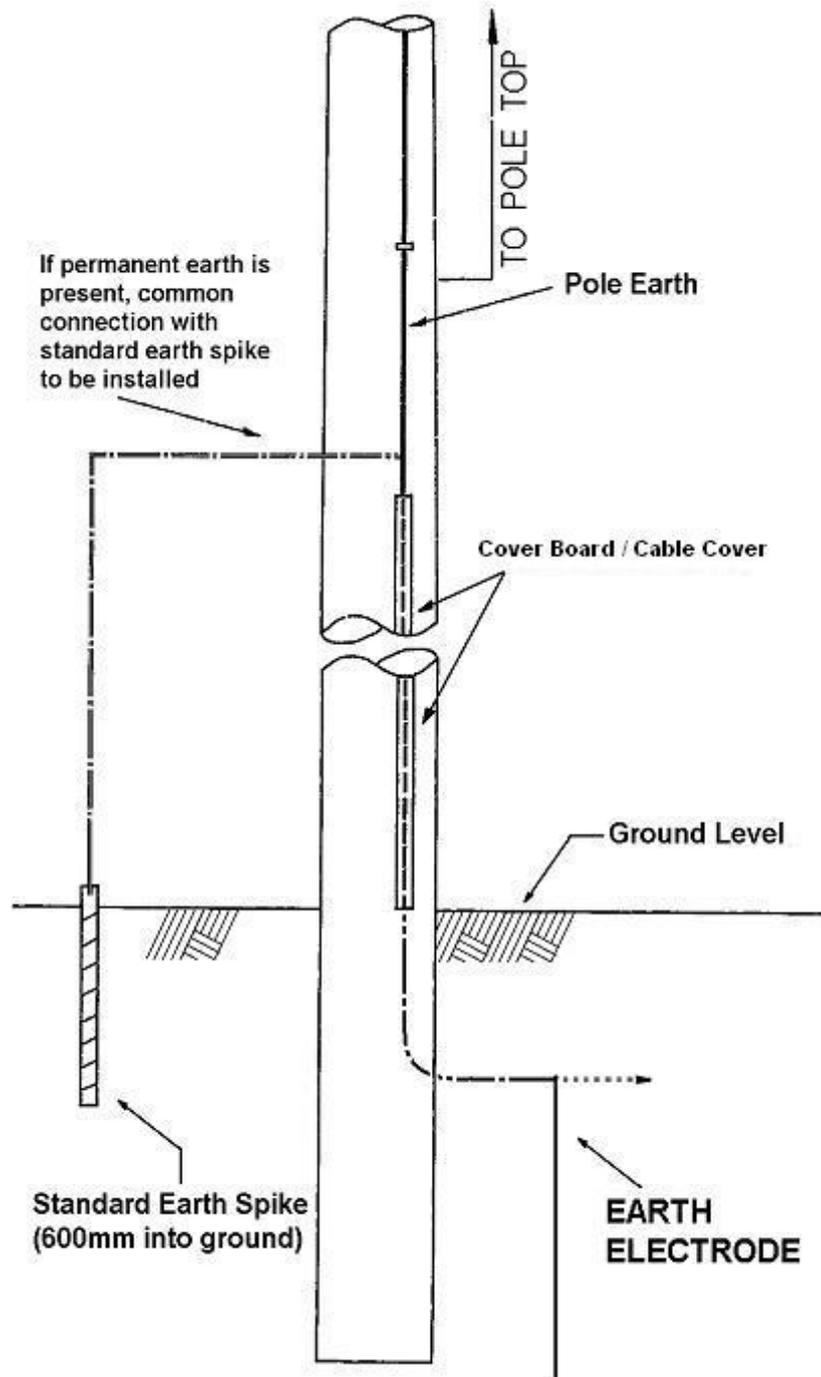


Figure 9: Earthing on a pole with a bare down lead

5.7 Breaking of Earthed Conductors

If an earthed conductor is broken or is to be broken, the two sides are to be bridged together via conductive bonds before bridging the two sides of the broken conductor by the body or hand; including via tools held by the hand. The bridging may be via another unbroken earthed phase or an unbroken aerial earth conductor (Figure 10).

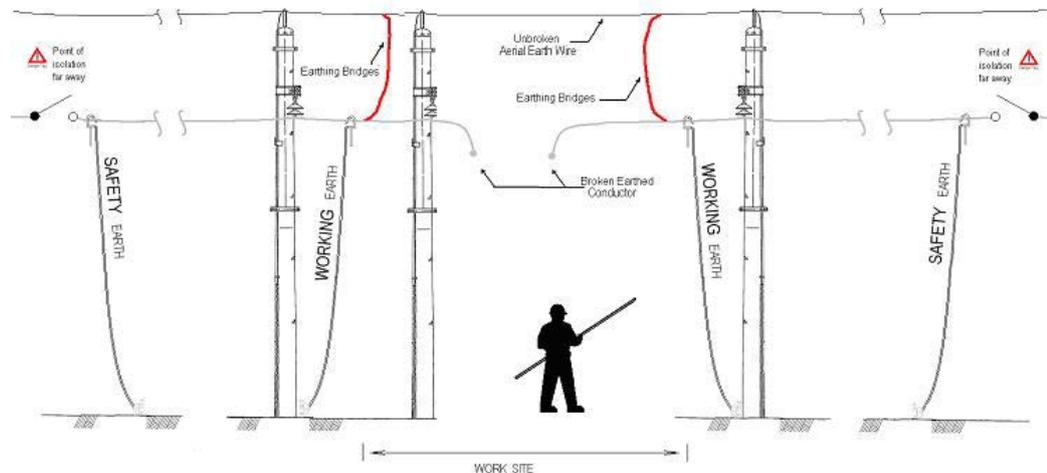


Figure 10: Bridging broken earthed conductors

5.8 Raising or lowering of aerial conductors

In cases where aerial conductors are being lowered to or raised from the ground in the vicinity of other services, an earth shall be attached to the conductor throughout the operation.

5.9 Areas Subject to Induced Voltages or an Increased Risk of Lightning Strikes

Additional working earths shall be applied where there is a risk of dangerous voltages being induced in the conductors being worked on from live aerial conductors in the area.

If it is necessary to work on an aerial conductor at a time when there is an increased risk due to lightning, all conductors, including aerial earth wires, shall be short-circuited together and earthed at **each** pole or structure being worked on.

NOTE

In general, only emergency work is permitted to continue at times when there is an increased risk due to lightning.

5.10 Removal of Portable Earths

WARNING

Connection to the permanent earth or earth spike, as applicable, shall not be broken until earthing connections to all aerial conductors have been removed first.

High Voltage aerial conductor earths shall be removed strictly in the following order:

- a. Loosen the conductor clamps by rotating the insulated operating sticks in an anti-clockwise direction. If screw type earth clamps are used, disconnect the conductor clamps from the aerial conductors. Ensure that only the ends of the operating sticks away from the conductor clamps are handled and that the earthing equipment does not come within the SADs set out in *PR D 78700 Working around Electrical Equipment* of any live conductor or Exposed Equipment, including Low Voltage and communications circuits. Disconnection shall first be made from the highest aerial conductor.

The person removing the earths shall maintain the SADs set out in PR D 78700 from the conductors from which earths have been removed.

- b. Lower the insulated sticks ensuring that the earthing equipment does not come within the Safe Approach Distances set out in PR D 78700 of any live conductor or Exposed Equipment, including Low Voltage and communications circuits.

After all earthing connections to aerial conductors have been removed, disconnect the earth end of the flexible cable from the permanent earth or the standard earth spike. Then remove the earth spike.

6 High Voltage Underground Cables to Aerial Equipment

NOTE

The following earthing method is to be used to perform cable testing.

6.1 Cable earthing from Pole A to Pole B

- a. Perform the appropriate proving dead and earthing method in accordance with Section 5 of this document.
- b. Place temporary bridging bonds from each cable end on the pole to the equipotential earth:
 - i. Drawing No. EL0052208 HV Aerial Lines - 66kV Polymeric Termination Underground to Overhead Pole top Arrangement shows the typical arrangement for bridging all "Cable to Aerial Termination Plates" (item 47) with "Connecting Plate for Earthing" (item 16).
 - ii. Similar arrangements for 11kV and 33kV are shown in Drawings No. EL0186406, EL0160722 and EL0455661.
 - iii. Other arrangements will require a risk assessment and SWMS to determine the best safe method to perform this step.
- c. Disconnect and remove bridges between the cables to the HV aerial line.
- d. Repeat steps (a) to (c) for Pole B.
- e. Conduct the cable tests at the appropriate pole as required.
- f. To remove earths, conduct the relevant steps of this procedure in the reverse order, i.e. step (d), then (c) and then step (b).

NOTE

Where practicable, cable tests should be performed inside the substation instead of the pole to remove the risk of working at heights.

6.2 Cable earthing from Pole to substation

- a. Perform the appropriate proving dead and earthing method in accordance with Section 5 of this document.
- b. Place temporary bridging bonds from each cable end on the pole to the equipotential earth.
 - i. Drawing No. EL0052208 HV Aerial Lines - 66kv Polymeric Termination Underground to Overhead Pole top Arrangement shows the typical arrangement for bridging all "Cable to Aerial Termination Plates" (item 47) with "Connecting Plate for Earthing" (item 16).
 - ii. Similar arrangements for 11kV and 33kV are shown in Drawings No. EL0186406, EL0160722 and EL0455661.
 - iii. Other arrangements will require a risk assessment and SWMS to determine the best safe method to perform this step.
- c. Disconnect and remove bridges between Cables to HV Aerial Line.
- d. Conduct the cable tests from inside the substation.
- e. To remove earths, conduct the relevant steps of this procedure in the reverse order, i.e. step (iii) and then step (ii).

7 Equipotential Bonding for Work on Conductive Poles/Structures

For work to be carried out on conductive poles/structures, it is essential to bond the earthed conductors to be worked on and the conductive pole/structure via the use of portable bonding equipment as shown in Appendix C.

8 Exposed High Voltage Outdoor Busbars at Substations

8.1 Earthing Equipment

The earthing equipment consists of:

- a. Three insulated sticks each fitted with a conductor connection clamp.
- b. An earth trifurcating plate.
- c. Flexible insulated cable for connection between the conductor clamp and the earth trifurcating plate.

If a set of portable earthing equipment has been subjected to fault current, the earthing equipment shall be immediately replaced with a set having equivalent rated current/rated time classification. The faulted set shall be withdrawn from service and all current carrying components shall be destroyed.

WARNING

Care shall be exercised when carrying earthing equipment to ensure that the equipment does not come within the Safe Approach Distances, specified in PR D 78700, of any live conductor or Exposed Equipment. Earth sticks shall be carried below shoulder level with the connection clamp end in front of the person carrying them.

8.2 Earthing Procedure

Ensure that the earthing equipment does not come within the Safe Approach Distances (SADs) of any live conductor or Exposed Equipment, as specified in PR D 78700. All phases of the HV equipment shall be **proved dead** before the **short circuiting** and **earthing** procedure is carried out, **strictly** in the following order:

- a. Check that the cable connections to the conductor clamps and the trifurcating plate are tight and that the cables are of sufficient length in accordance with SP D 79043.
- b. Connect the trifurcating plate to the appropriate substation earth point. Refer to Figure 11.

- c. Connect the conductor clamps to each phase conductor of the HV equipment.

Connection to an overhead line conductor shall be made by drawing the hooked section of the conductor clamp firmly and smartly onto the overhead line conductor. Tighten the screw type earth connection clamps by rotating the insulated operating stick in a clockwise direction.

Earthing points are provided on certain HV equipment for the attachment of the earthing clamps.



Figure 11: Typical Substation Earthing disc and Earthing Point

8.3 Removal of Earths

Ensure that the earthing equipment does not come within the SADs of any live conductor or Exposed Equipment, as specified in PR D 78700. HV overhead line earths shall be removed **strictly** in the following order:

- a. Loosen screw type earth connection clamps by rotating the insulated operating stick in an anti-clockwise direction. Disconnect the conductor clamps from the overhead line conductors ensuring that only the ends of the operating sticks away from the conductor clamps are handled.
- b. Disconnection shall first be made from the highest overhead line conductor.
- c. Disconnect the trifurcating plate from the substation earth point.

8.4 Connection to High Busbars

In some substations, there are high level conductors that are too high to allow a person to safely and/or practically connect the earthing set to them.

In cases such as this, the earth can be connected from the closest accessible area at ground level as long as there is an electrically continuous connection to the point that they would have normally been connected.

The typical arrangement for earthing high level busbars in a substation is illustrated in Figure 12.

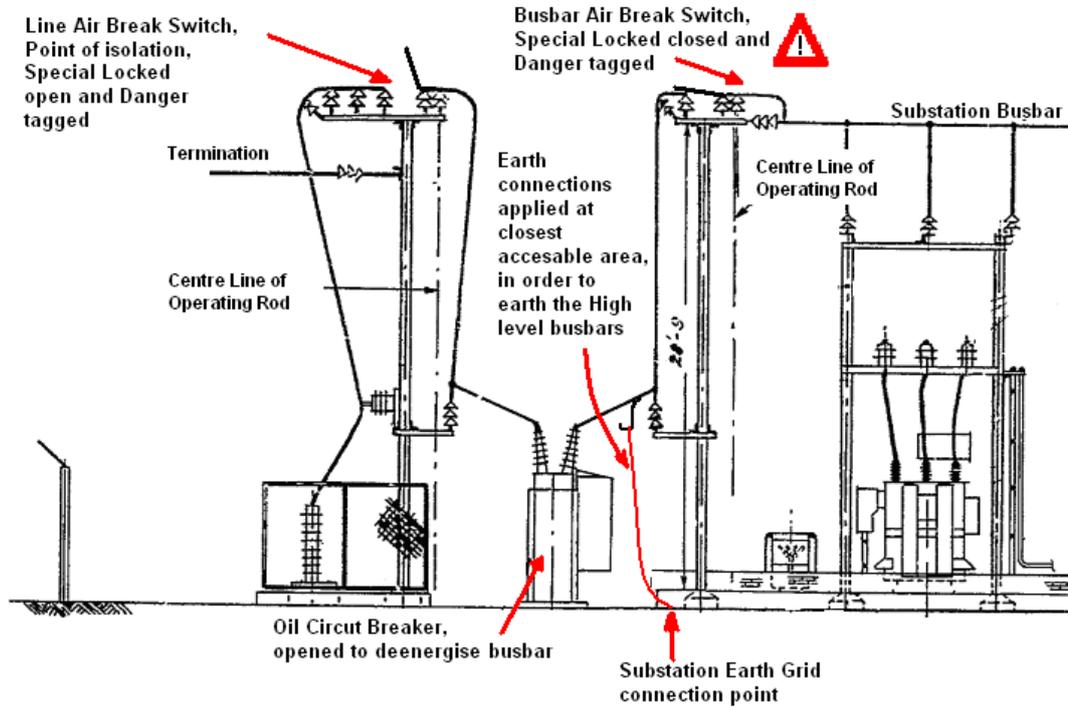


Figure 12: Typical arrangement for earthing high level bus bars in a substation

WARNING
 Any switch that shall be closed in order to maintain an electrically continuous connection for earthing, shall be Special Locked and Danger Tagged closed. Refer to PR D 78104 Securing Systems for Electrical Equipment.

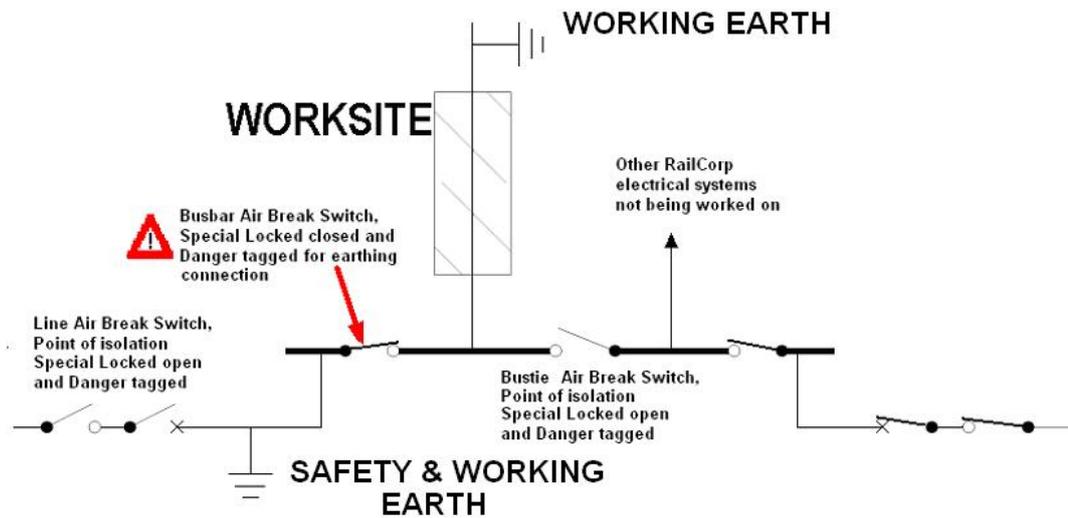


Figure 13: Applying safety and working earths on high level busbars

9 Reference documents

NMD-NOM-PR-433 Minor Plant Equipment Procedure

PR D 78104 Securing Systems for Electrical Equipment

PR D 78203 High Voltage Operating Procedure

PR D 78700 Working around Electrical Equipment

RL D 79800 Electrical Network Safety Rules

SMS-06-GD-3144 Guide to Excavations and Earthworks

SP D 79033 Requirements for Portable Earthing Equipment for the High Voltage System

SP D 79043 Inspection and Care of Portable Earthing Equipment for the High Voltage System

SP D 79049 Safe Approach Distances (SADs)

Appendix A Overhead Line Series Connected Earthing Equipment

The diagram illustrates the assembly of earthing equipment for overhead lines. It shows a series of vertical sticks of increasing height (1m, 2m, 3m) connected by cables with lugs. An earth spike is attached to the top of the 3m stick, and an earth spike clamp is attached to the bottom of the 1m stick. The entire assembly is supported by a carry bag and parking bar.

NOTES:

1. TO BE MANUFACTURED, INSPECTED AND TESTED IN ACCORDANCE WITH ELECTRICAL STANDARDS SPECIFICATION A-841.
2. REFER TO DRAWING D/88587 SHEET 2 FOR LOCATION OF LABELS ON EARTHING STICKS & CABLES.
3. STICK 'E' REQUIRED FOR EARTHING OVERHEAD EARTH WIRE, WHERE INSTALLED.

ITEM No.	DESCRIPTION	QTY.
10	CARRY BAG (NOT SHOWN)	1
9	PARKING BAR (NOT SHOWN)	1
8	SET SCREWS, NUTS, WASHERS, SPRING WASHERS, ETC.	AS REQD.
7	EARTHING STICK (DEDICATED)	4
6	CABLE (5 metres) WITH LUGS	1
5	CABLE (4 metres) WITH LUGS	2
4	CABLE (20 metres) WITH LUGS	1
3	EARTH SPIKE (PREFERRED SPIKE TO DRAWING E/53982)	1
2	EARTH SPIKE CLAMP	1
1	LINE CLAMP	4

EDMS EL0004239 WARNING SCANNED IMAGE

DRAWING REFERENCE EARTH SPIKE DRAWING E/53982.	STATE RAIL AUTHORITY OF NSW CITYRAIL ENGINEERING – ELECTRICAL	Passed	Dm	APPROVED
	TRANSMISSION LINES PORTABLE EARTHING EQUIPMENT GENERAL ARRANGEMENT		Top	<i>[Signature]</i>
			Clid	ELECTRICAL STANDARDS ENGINEER
			Scale	D 88587 SH 1
				No 1
				A B

A ORIGINAL ISSUE
B STICK 'E' WORK
C DRAWING WORK
Dm: [Signature] 2022-01-19
Top: [Signature] 2022-01-19
Clid: [Signature] 2022-01-19
Scale: 1:1

Appendix B Overhead Line Star Connected Earthing Equipment

NOTES:

1. TO BE MANUFACTURED, INSPECTED AND TESTED IN ACCORDANCE WITH ELECTRICAL STANDARDS SPECIFICATION A-841.
2. REFER TO DRAWING D/88587 SHEET 2 FOR LOCATION OF LABELS ON EARTHING STICKS & CABLES
3. STICK "E" REQUIRED FOR EARTHING OVERHEAD EARTH WIRE, WHERE INSTALLED.

10	CARRY BAG (NOT SHOWN)	1	QTY.
9	PARKING BAR	1	
8	SET SCREWS, NUT, WASHERS, SPRING WASHERS, ETC	AS REQ'D	
7	EARTHING STICK (DEDICATED)	4	
6	CABLE (5 metres) WITH LUGS	1	
5	CABLE (4 metres) WITH LUGS	3	
4	CABLE (18 metres) WITH LUGS	1	
3	EARTH SPIKE (PREFERRED SPIKE TO DRAWING E/53982)	1	
2	EARTH SPIKE CLAMP	1	
1	LINE CLAMP	4	


EDMS EL0027468 WARNING SCANNED IMAGE

DRAWING REFERENCE
 EARTH SPIKE DRAWING
 E/53982

APPROVED	DIN	TOD	CHK	SCALE	ST/IA No.
<i>[Signature]</i>	1	1	1	1	D 88587
ELECTRICAL STANDARD ENGINEER					No.

STATE RAIL AUTHORITY OF N.S.W
 CITY RAIL ENGINEERING – ELECTRICAL
 TRANSMISSION LINES
 PORTABLE EARTHING
 EQUIPMENT
 GENERAL ARRANGEMENT

Appendix C Portable Bonding Equipment

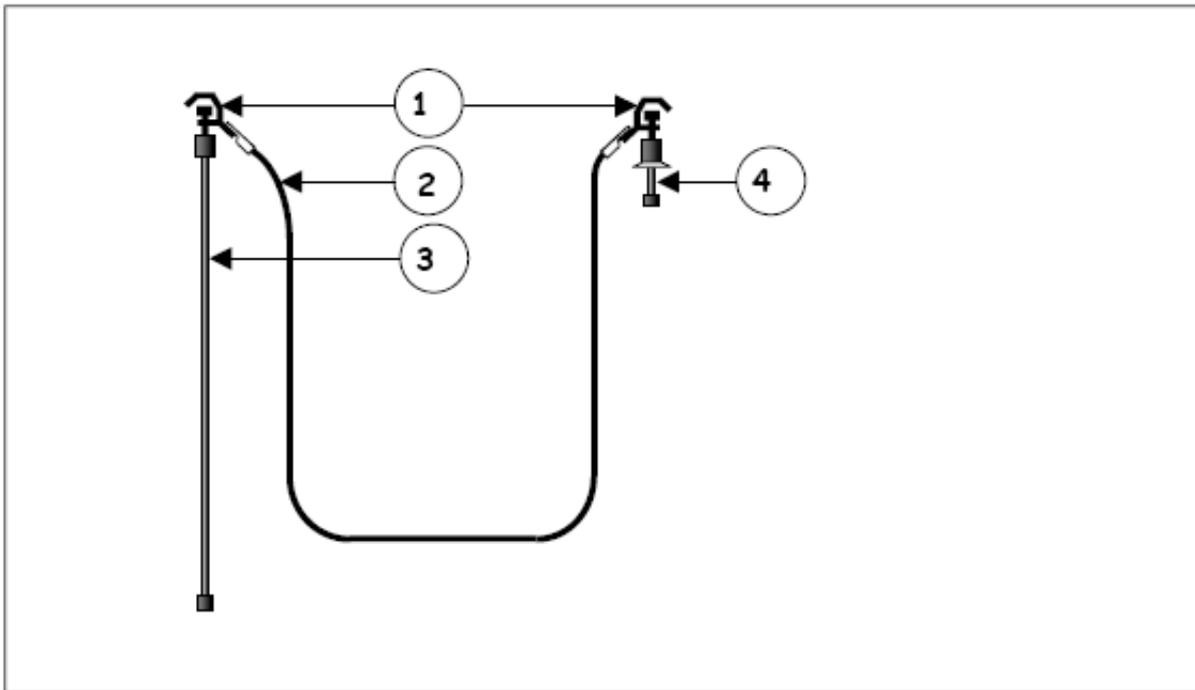

6	Carry bag (not shown)	1
5	Set screws, nuts, washers, spring washers etc.	As required
4	Dedicated insulated handle or Detachable insulated handle	1
3	Dedicated insulated stick or Detachable insulated stick	1
2	5 metres Cable with lugs	1
1	Line clamp	2
Item No.	Description	Quantity