

Engineering System Integrity

Engineering Instruction

Electrical Distribution Unit

EI D 26-06

Dehn D.C. Voltage Detectors - Identification and Use

This Engineering Instruction includes urgent engineering information. Adherence to the information in this Instruction is **MANDATORY**.

Date in Force: 27 July 2026

Date of Review: 27 July 2027

Approved by:

Sean Budge
Associate Director
Electrical Distribution Unit

Authorised by:

Bahieya Sipos
A/Engineering Technical
Publications Manager

Audience:

- Authorised Operator
- Authorised Officer Substations
- Electrical Engineers

Main Points:

- Dehn D.C. voltage detectors shall be labelled stating indicated voltage and location
- Dehn D.C. voltage detectors may be used for proving 1500 V DC supply has been removed
- Use a multimeter to prove equipment is safe to touch.

Primary Affected Document: SP D 79039 Electrical Tools and Test Equipment

Document Control

Version	Date	Summary of change
1.0	27 July 2026	First issue as a Sydney Trains document

Scope

This Engineering Instruction details the identification of Dehn D.C. voltage detectors and a further requirement to confirm equipment is safe to access.



OFFICIAL

Disclaimer

This document was prepared for use by Sydney Trains and its intended recipient. The information in this document is protected by copyright and no part of this document may be reproduced, altered, stored or transmitted by any person without the prior consent of Sydney Trains. Errors or omissions in this document should be reported to sydneytrainsstandards@transport.nsw.gov.au. Sydney Trains makes no warranties, express or implied, that compliance with the contents of this document shall be sufficient to ensure safe systems or work or operation.

Background

Dehn D.C. voltage detectors are used within Sydney Trains substations to prove that the 1500 V D.C. supply has been de-energised. Several models of Dehn voltage detectors are in service, each with different voltage indication thresholds. These thresholds (refer Table 1 below) are not always readily obvious to the user and, depending on the model, may not be suitable for verifying that equipment is touch safe.

Care must therefore be taken to ensure the voltage detector used is appropriate for the intended task, particularly where confirmation of a touch-safe voltage of 120 V D.C. or less is required.

Voltage Threshold

Model Number

Part number



EDU are currently evaluating a new type of D.C. voltage detector suitable for substations.

Action required

- For work within substations or sectioning huts on equipment that is isolated but not rail connect, after proving the supply is de-energised and before accessing the equipment, verify that the equipment is touch-safe using a voltmeter. The voltage reading must be 120 V D.C. or less.
- All Dehn voltage detectors to be recorded in the database located in the substation [ST-Substations SharePoint](#).
- All Dehn voltage detectors shall have a label applied near the handle for their indication voltage and nominated location, e.g. substation.

Table 1: Dehn D.C. voltage detector models and voltage indication

Model	Part Number	Voltage (Threshold) Indication
PHEG2 P SN7194	767637	750
PHEG2 P SN7194	767602 and 767602S	750
PHEG2 SN7259	767645	120
PHEG2 SN7552	767647	90
PHEG2.P SN7517	767671	90
PHEG2.P SN7629	767681	120
PHEG2.PSN7518	767694	50

- Until a new detector is approved, Dehn PHEG2.D SN 7517 Part Number 767671 may be purchased from Asia Pacific Dehn distributors listed at [Australian - Partner weltweit | DEHN](#)

Associated Competencies

As per EI audience on Page 1.

Contact

Rail Electrical Safety: railelectricalsafety@transport.nsw.gov.au

OFFICIAL

**Engineering System Integrity
Electrical Network Safety Rules**

**Engineering Specification
Electrical Distribution Unit**

One Method of Safe Working

SP D 79039

**Electrical Tools and Test
Equipment**

Version 2.1

Date in Force: 25 February 2026

Approved by: Associate Director
Electrical Distribution Unit
Engineering System Integrity

Authorised by: Engineering Technical
Publications Manager
System Integrity

Disclaimer

This document was prepared for use by persons in connection with works near or on/within the rail network electricity system operated by Sydney Trains. Sydney Trains makes no warranties, express or implied, that compliance with the contents of this document shall be sufficient to ensure safe systems or work or operation. It is the document user's sole responsibility to ensure that the copy of the document it is viewing is the current version of the document as in use by Sydney Trains. To the extent permitted by law, Sydney Trains excludes any and all liability for any loss or damage, however caused (including through negligence), which may be directly or indirectly suffered in connection with the use of this document.

Copyright

The information in this document is protected by copyright and no part of this document may be reproduced, altered, stored, or transmitted by any person without the prior consent of Sydney Trains.

Document control

Version	Date	Author/ Prin. Eng.	Summary of change
1.0	10 September 2020	Nick Loveday	First issue
1.1	25 September 2020	Nick Loveday	Detailed procedure for operating the Hivotech OHW Tester inserted
1.2	1 February 2020	Nick Loveday	Revised approved 11 - 66kV HV Testers
1.3	17 February 2020	Nick Loveday	Revised approved HV Testers at 5.1-5.3
1.4	1 February 2022	ENSR Project Team	Reviewed as part of the ENSR Project.
1.5	1 November 2022	Wayne Halls	Removed detail procedure for Hivotech. Reference to SWI's hivotech, catu775 Catu CM46 Range. Emphasised special insulated apparatus, not accessories. Updated LV non-contact detectors. Updated HV and insulated sticks.
2.0	3 November 2025	Deepak Sinha	Added FAMECA Penta pole
2.1	25 February 2026	Deepak Sinha	Added FAMECA TAG330 Added Hasting 839-2 extension stick

Summary of changes from previous version

Summary of change	Section
Added FAMECA TAG330, Added Hasting 839-2 extension stick	6.3 & 7.2

Table of Contents

1	Introduction	4
2	Definitions.....	4
3	Scope.....	4
4	Information	4
5	Portable Connections	5
5.1	1500 Volt portable rail connection.....	5
5.2	HVAC overhead line star-connected earthing equipment.....	6
5.3	HVAC overhead line series-connected earthing equipment.....	6
6	Test equipment.....	7
6.1	TAPLIN D225/M 11kV – 132kV High Voltage Tester	7
6.2	11kV – 66kV High Voltage Detectors.....	8
6.3	132 kV High Voltage Detectors	9
6.4	Hivotech 1500V DC OHW tester.....	9
6.5	1500 Volt DC rail clamp	10
6.6	1500V DC Substation Testers	11
6.7	LR tester.....	13
6.8	OHW structure-to-rail voltage test kit.....	14
6.9	Low Voltage Non-Contact Detectors.....	15
6.10	Phase-test lamps	16
6.11	Multimeter – phase identification	16
7	Specially Insulated Apparatus	17
7.1	HV insulated stick.....	17
7.2	Extension Stick.....	18
7.3	Round measuring telescopic stick	18
7.4	Operating stick – dense foam filled	19
7.5	OHW/Rail connection insulated sticks	20
7.6	1500 Volt DC insulated stick – foam filled.....	21
7.7	1500 Volt DC operating and measuring telescopic sticks.....	21
7.8	Live line rope insulator	22
7.9	FAMECA Penta Pole Insulated Stick	24
8	Assemblies and Kits.....	24
8.1	Live low-voltage rescue kit.....	24
8.2	Pole-top rescue kit	25
8.3	Pole marker	26
8.4	Substation demarcation taping equipment.....	26
8.5	1500 Volt OHW Attached Climbing Kit Assembly	28
9	Reference documents.....	29

1 Introduction

This document describes the tools and test equipment approved by Sydney Trains per *GL D 79106 Selection and Approval of Tools and Test Equipment* for use by persons holding an electrical authorisation in accordance with *PR D 78701 Personnel Certifications – Electrical* when performing electrical work on low-voltage, 1500 Volt DC or high voltage equipment.

2 Definitions

Refer to the **Electrical Safety Definitions** page available on the **RAILSAFE** website.

3 Scope

Where the Electricity Network Safety Rules require approved equipment to be used, that means an item nominated in this specification.

Where the Electricity Network Safety Rules do not require approved equipment to be used, an authorised person may choose commercially available equipment suitable for the task.

Equipment that loses approval status will be removed from this document.

4 Information

The following information is provided:

Equipment Name – the short name of the item.

Make & Model – the original equipment manufacturer (OEM) and model number, including the version (if relevant).

Source(s) – the preferred supplier of the equipment (if not the OEM).

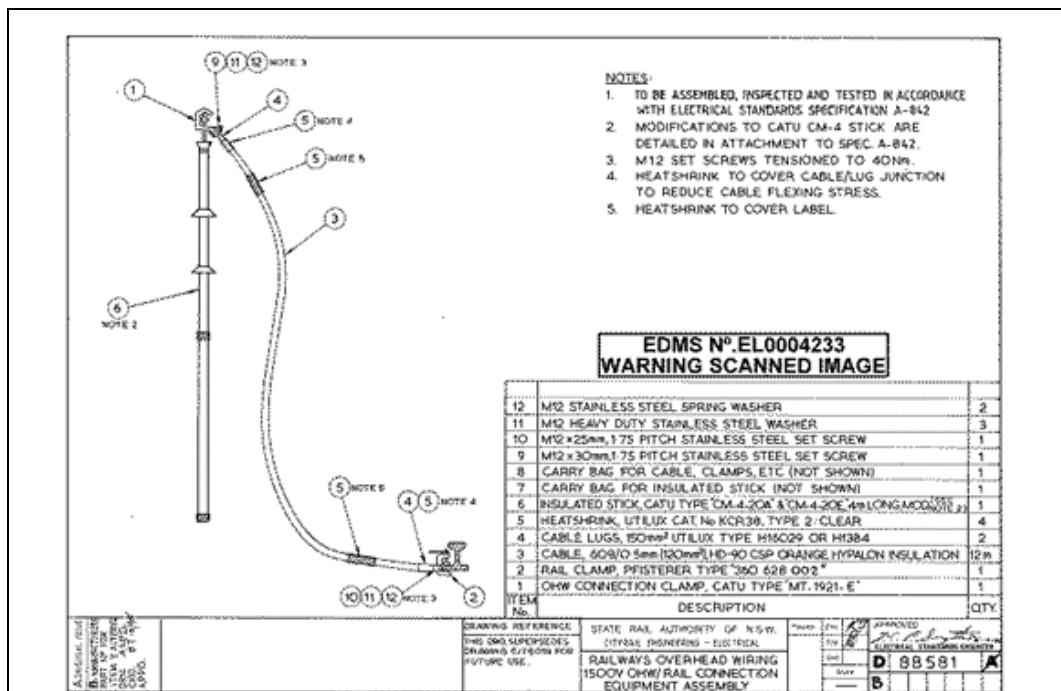
Applications – its intended purpose(s).

Documentation – List of the available documentation such assembly, instructions, SWMS and SWIs etc.
RM8 Document storage location.

Limitations – any constraints or known issues with the use of the equipment.

5 Portable Connections

5.1 1500 Volt portable rail connection



ITEM No.	DESCRIPTION	QTY.
12	M12 STAINLESS STEEL SPRING WASHER	2
11	M12 HEAVY DUTY STAINLESS STEEL WASHER	3
10	M12 x 25mm, 1.75 PITCH STAINLESS STEEL SET SCREW	1
9	M12 x 30mm, 1.75 PITCH STAINLESS STEEL SET SCREW	1
8	CARRY BAG FOR CABLE, CLAMPS, ETC. (NOT SHOWN)	1
7	CARRY BAG FOR INSULATED STICK (NOT SHOWN)	1
6	INSULATED STICK, CATU TYPE CM-4-20A 1CM-4-20C 4m LONG	1
5	HEATSHRINK, UTILUX CAT No KCR38, TYPE 2 CLEAR	4
4	CABLE LUGS, 150mm² UTILUX TYPE HMC029 OR H1384	2
3	CABLE, 60/10 5mm (120mm²) HD-90 CSP ORANGE NYLON INSULATION	12m
2	RAIL CLAMP, PFIESTER TYPE 350 628 002	1
1	OHW CONNECTION CLAMP, CATU TYPE MT. 1921-E	1

Equipment Name	1500 Volt Portable Rail Connection
Make & Model	Thew & McCann
Source(s)	TMAC
Application	For making a temporary connection between 1500 Volt DC equipment (usually overhead wire) and the traction return rail
Documentation	Assembly drawing EL0004233 SP D 79045 Portable Rail Connecting Equipment for 1500 Volt Overhead Wiring
Limitations	Portable bridging equipment shall not be used at feeding air gaps, to provide continuity of rail connection between sections. If this were done, the equipment could be inadvertently left in place at the end of the job, resulting in pantograph damage and preventing the protection system from operating effectively.

The 1500 Volt portable rail connection equipment consists of an OHW connection clamp, a rail clamp and approximately 12m of 120mm² flexible insulated cable for connection between the two clamps.

The cable and clamps are used in conjunction with a 4m fibreglass two-piece stick fitted with a bayonet socket for attachment and detachment of the OHW connection clamp to the stick. The OHW connection clamp is a screw type, operated by rotating the insulated stick.

A second OHW connection clamp may be connected to the first by a short length of 120mm² insulated cable to allow two sections of overhead wiring over the same track to be rail connected via the one rail clamp. Two sets of fibreglass sticks will be required.



Portable Rail Connecting Clamp

5.2 HVAC overhead line star-connected earthing equipment

Equipment Name	HVAC Overhead Line Star Connected Earthing Equipment
Make & Model	Thew & McCann
Source(s)	TMAC
Application	For making a temporary connection between high-voltage equipment and earth
Documentation	EL0027468 and <i>SP D 79047 Earthing High Voltage Equipment using Portable Earthing Equipment</i> Appendix B Overhead Line Star Connected Earthing Equipment <i>SP D 79033 Requirements for Portable Earthing Equipment for the High Voltage System</i>
Limitations	–

5.3 HVAC overhead line series-connected earthing equipment

		NOTES: 1. TO BE MANUFACTURED, INSPECTED AND TESTED IN ACCORDANCE WITH ELECTRICAL STANDARDS SPECIFICATION A-841. 2. REFER TO DRAWING D/88587 SHEET 2 FOR LOCATION OF LABELS ON EARTHING STICKS & CABLES. 3. STICK 'E' REQUIRED FOR EARTHING OVERHEAD EARTH WIRE, WHERE INSTALLED.																																		
EDMS EL0004239 WARNING SCANNED IMAGE		<table><tr><th>ITEM No.</th><th>DESCRIPTION</th><th>QTY.</th></tr><tr><td>10</td><td>CARRY BAG (NOT SHOWN)</td><td>1</td></tr><tr><td>9</td><td>PARKING BAR (NOT SHOWN)</td><td>1</td></tr><tr><td>8</td><td>SET SCREWS, NUTS, WASHERS, SPRING WASHERS, ETC.</td><td>1</td></tr><tr><td>7</td><td>EARTHING STICK (DEDICATED)</td><td>4</td></tr><tr><td>6</td><td>CABLE (5metres) WITH LUGS</td><td>1</td></tr><tr><td>5</td><td>CABLE (4 metres) WITH LUGS</td><td>2</td></tr><tr><td>4</td><td>CABLE (20 metres) WITH LUGS</td><td>1</td></tr><tr><td>3</td><td>EARTH SPIKE (PREFERRED SPIKE TO DRAWING E/53982)</td><td>1</td></tr><tr><td>2</td><td>EARTH SPIKE CLAMP</td><td>1</td></tr><tr><td>1</td><td>LINE CLAMP</td><td>4</td></tr></table>		ITEM No.	DESCRIPTION	QTY.	10	CARRY BAG (NOT SHOWN)	1	9	PARKING BAR (NOT SHOWN)	1	8	SET SCREWS, NUTS, WASHERS, SPRING WASHERS, ETC.	1	7	EARTHING STICK (DEDICATED)	4	6	CABLE (5metres) WITH LUGS	1	5	CABLE (4 metres) WITH LUGS	2	4	CABLE (20 metres) WITH LUGS	1	3	EARTH SPIKE (PREFERRED SPIKE TO DRAWING E/53982)	1	2	EARTH SPIKE CLAMP	1	1	LINE CLAMP	4
ITEM No.	DESCRIPTION	QTY.																																		
10	CARRY BAG (NOT SHOWN)	1																																		
9	PARKING BAR (NOT SHOWN)	1																																		
8	SET SCREWS, NUTS, WASHERS, SPRING WASHERS, ETC.	1																																		
7	EARTHING STICK (DEDICATED)	4																																		
6	CABLE (5metres) WITH LUGS	1																																		
5	CABLE (4 metres) WITH LUGS	2																																		
4	CABLE (20 metres) WITH LUGS	1																																		
3	EARTH SPIKE (PREFERRED SPIKE TO DRAWING E/53982)	1																																		
2	EARTH SPIKE CLAMP	1																																		
1	LINE CLAMP	4																																		
DRAWING REFERENCE EARTH SPIKE DRAWING E/53982.		STATE RAIL AUTHORITY OF NSW CENTRAL ENGINEERING - ELECTRICAL TRANSMISSION LINES PORTABLE EARTHING EQUIPMENT GENERAL ARRANGEMENT																																		
ASSEMBLY CODE Z 130272700 Z 130272700 Z 130272700		APPROVED: [Signature] ELECTRICAL STANDARDS ENGINEER D/88587 R01																																		

Equipment Name	HVAC Overhead Line Series Connected Earthing Equipment
Make & Model	Thew & McCann
Source(s)	TMAC
Application	For making a temporary connection between high-voltage equipment and earth.
Documentation	EL0004239 and SP D 79047 Earthing High Voltage Equipment using Portable Earthing Equipment Appendix A Overhead Line Series Connected Earthing Equipment SP D 79033 Requirements for Portable Earthing Equipment for the High Voltage System
Limitations	-

6 Test equipment

6.1 TAPLIN D225/M 11kV – 132kV High Voltage Tester



Equipment Name	11kV – 132kV High Voltage Tester
Make & Model	ABB TAPLIN D225/M
Source(s)	GTR Electrics (Gary Rogers) - No longer Available
Application	Testing for live HV equipment.
Documentation	<i>DSYD2022/61355 D225/M Electronic HV Line Tester- Operators Instructions</i> <i>PR D 78203 High Voltage Operating Procedure</i> <i>FSYD2022/6404 High Voltage AC Tester ABB D225/M</i>
Limitations	-

6.2 11kV – 66kV High Voltage Detectors

	
Equipment Name	11-66kV High Voltage Tester
Make & Model	Fameca Tag2020
Source(s)	Hylec Energy Solutions
Application	Testing for live HV equipment.
Documentation	<i>D2021/6520 Use of approved High Voltage Contact Detectors – FAMECA TAG2020</i> <i>PR D 78203 High Voltage Operating Procedure</i> <i>TfNSW standard EP 15 00 00 01 SP High Voltage AC Voltage Detector (Nominal Voltage of 11kV - 66kV)</i> <i>FSYD2022/6271 High Voltage AC Tester Famica Tag 2020</i>
Limitations	Nominal Voltage of 11kV - 66kV

	
Equipment Name	11kV - 66kV High Voltage Tester
Make & Model	CATU 775
Source(s)	Sicame Australia Pty Ltd
Application	Testing for live HV equipment.
Documentation	<i>D2022/4477 Use of Approved High Voltage AC Contact Voltage Detectors – CATU CC775</i> <i>PR D 78203 High Voltage Operating Procedure</i> <i>TfNSW standard EP 15 00 00 01 SP High Voltage AC Voltage Detector (Nominal Voltage of 11kV - 66kV)</i> <i>FSYD2022/6271 High Voltage AC Detector Catu CC775</i>
Limitations	Nominal Voltage of 11kV - 66kV

6.3 132 kV High Voltage Detectors

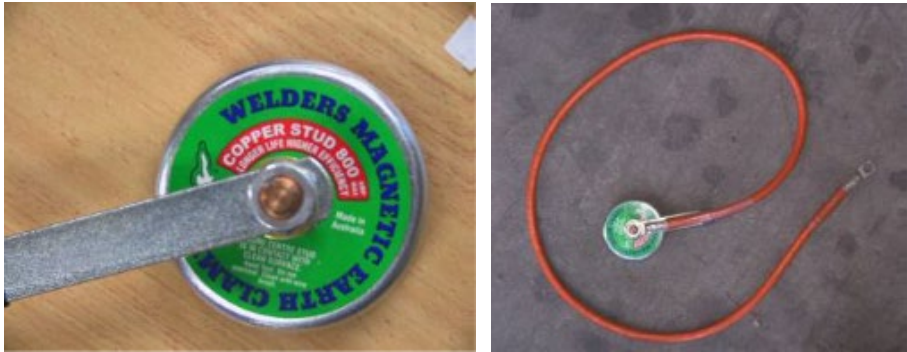
	
Equipment Name	132kV High Voltage Tester
Make & Model	FAMECA Tag330
Source(s)	Hylec Energy Solutions
Application	Testing for live HV equipment.
Documentation	SWI221 FAMECA TAG330 PR D 78203 High Voltage Operating Procedure FSYD2023/7845 High Voltage AC Tester Fameca Tag 330
Limitations	Nominal Voltage upto 132 KV. Confirm on the label that the operating frequency is 50Hz Do not keep the tester in contact with aerial line under rain for more than 1 min.

6.4 Hivotech 1500V DC OHW tester

	
Equipment Name	Hivotech 1500 Volt DC Tester
Make & Model	Hivotech DE-300/1
Source(s)	IPD
Application	Testing for 1500 Volt DC outside substations.

Documentation	<i>D2022/4012 Hivotech 1500V DC OHW Tester application and functions</i> <i>PR D 78305 1500 Volt Operating Procedures</i> <i>SP E 79030 Voltage Detector for use on 1500V DC Overhead Wiring</i> <i>FSYD2022/717 1500V DC OHW Tester Hivotech 300-1</i>
Limitations	Not suitable for use within or on substation equipment with the exception of the OHW side of a point of isolation

6.5 1500 Volt DC rail clamp

	
Equipment Name	1500 Volt DC Rail Clamp (Magnetic)
Make & Model	Welder's Magnetic Clamp assembly
Source(s)	
Application	For use with both the LR Tester and/or Hivotech 1500 Volt DC OHW Tester. Provides a temporary connection to a rail.
Documentation	<i>PR D 78305 1500 Volt Operating Procedures</i>
Limitations	Requires a clean contact - Cannot be applied to painted or heavily corroded surfaces

	
Equipment Name	1500V DC rail clamp (screw)

Make & Model	Thew & McCann Type No. 360 628 002
Source(s)	Pfisterer, TMAC
Application	Provides a temporary connection to a rail.
Documentation	<i>PR D 78305 1500 Volt Operating Procedures</i> The cable used to attach above clamps onto the LR Tester is specified as follows: • Cable type – 25 mm², Olex Versolex HD s/c power/welding cable, 0.6/1kV, flexible XLPE insulated and TPE sheathed to AS/NZS 5000.1 and AS/NZS 1995, preferably with the clear and transparent cable sheath. • Cable lug – 25 mm², Utilux copper crimp lugs, M12 stud size, Catalogue No. H1416B/50, Tooling #20 38-77CU. • Cable length -sufficient length to allow the use of the LR Tester from ground level and suitable for easy storage.
Limitations	–

6.6 1500V DC Substation Testers

	
Equipment Name	1500 Volt DC Substation Tester
Make & Model	DEHN
Source(s)	IPD
Application	For testing 1500 Volt equipment inside substations
Documentation	DSYD2022/78734 DEHN 1500V DC Substation Tester – Operators Instructions PR D 78305 1500 Volt Operating Procedures FSYD2022/6457 1500V Substation Tester - DEHN
Limitations	-



Equipment Name	Substation 1500 Volt DC 2-Pole
Make & Model	Hollow Tube Conduit (HTC) Tester
Source(s)	PTC - Not Available
Application	For testing 1500V equipment inside substations
Documentation	<i>PR D 78305 1500 Volt Operating Procedures</i> FSYD2022/6458 DC Substation Tester - HTC
Limitations	

6.7 LR tester



Equipment Name	Line to Rail (LR) Tester
Make & Model	PTC -
Source(s)	PTC - Not Available
Application	Continuity testing of rail-connecting cables at 1500 Volt field switches.
Documentation	<i>PR D 78305 1500 Volt Operating Procedures</i>
Limitations	Not to be used for testing dead

6.8 OHW structure-to-rail voltage test kit

	
Equipment Name	OHW structure to rail voltage test kit
Make & Model	Kit comprised of: 1. Fluke series 170 digital multimeter 2. Fluke C70Y yellow holster 3. Fluke 80K-6 high voltage probe (earth lead lengthened to 5m) 4. 5m extension earth lead 5. Rail clip with 300mm earth lead tail 6. 300mm earth lead tail with 10mm termination eye for attachment to rail vehicles 7. An uncontrolled copy of PR D 78306 8. 9 Volt Battery (Eveready No. 216 6F22 or similar) 9. Plastic tool box for storage of the test equipment.
Source(s)	Fluke where indicated, and commercially available suppliers.
Application	
Documentation	<i>PR D 78306 1500 Volt DC Overhead Wiring Structure to Rail Voltage Test</i>
Limitations	–

6.9 Low Voltage Non-Contact Detectors

	
Equipment Name	LV non-contact Proximity Detector
Make & Model	Hioki 3481-20
Source(s)	Commercially available – e.g. Rexel, Blackwoods, etc.
Application	Non-contact LV proximity detection
Documentation	<i>DSYD2022/97528 3481D980-01 Instruction Manual</i> <i>PR D 78402 Work on the Low Voltage Distribution System</i> <i>FSYD2022/97528 Hioki 3481-20 LV non-contact detector</i>
Limitations	–

	
Equipment Name	Non-contact LV Proximity Detector
Make & Model	Greenlee GT-13
Source(s)	Commercially available – e.g. Rexel, Blackwoods, etc.
Application	Non-contact LV proximity detection
Documentation	<i>DSYD2022/97520 52087541 rev3 Instruction Manual</i> <i>PR D 78402 Work on the Low Voltage Distribution System</i> <i>FSYD2022/97520 Greenlee GT13 LV non-contact detector</i>
Limitations	–

6.10 Phase-test lamps

Equipment Name	Various
Make & Model	Various
Source(s)	Commercially available – e.g. TMAC, TEN Group, etc. Non-contact types are preferred.
Application	Phase identification of 3-phase low voltage services.
Documentation	<i>PR D 78402 Work on the Low Voltage Distribution System</i>
Limitations	–

6.11 Multimeter – phase identification

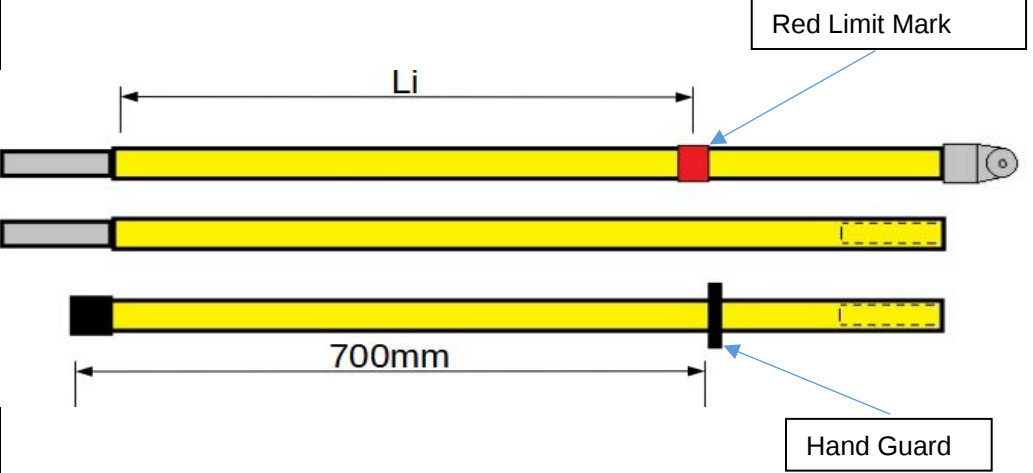
Equipment Name	Various
Make & Model	Various
Source(s)	Commercially available – e.g. Blackwoods, Rexel, etc.
Application	Phase identification of 3-phase low voltage services.
Documentation	<i>PR D 78402 Work on the Low Voltage Distribution System</i>
Limitations	–

7 Specially Insulated Apparatus

Specially insulated apparatus per the ENSRs provide the safety medium to ensure the operator does not encroach the SAD.

Accessories for the tools shall be risk assessed for suitability for the task by the operator and therefore do not require inclusion in this document

7.1 HV insulated stick

	
Equipment Name	HV insulated stick
Make & Model	Various
Source(s)	Various
Application	Electrically insulated tools and equipment for use near or on/within of LIVE HV equipment.
Documentation	<i>PR D 78203 High Voltage Operating Procedure</i> <i>Sydney Trains ESI Electrical Manual EP 15 00 00 01 SP High Voltage AC Voltage Detector (Nominal Voltage of 11kV - 66kV)</i> <i>IEC 61243-1 Live Working-Voltage Detectors Pt1</i>
Limitations	To suit high non-linear resonance systems with auto reclose operation.

HV insulated sticks shall have a solid or foam-filled insulating element.

The insulating element may be of multiple portions to a length (Li), to suit the required 3 phase system voltage, conductive portions excluded.

The length of the insulating element is indicated by a Red Limit Mark.

Note: When the Limit Mark is absent, the limit shall be at the extent of the insulating element.

System Voltage	Insulating Element (Li)
≤66 kV	830mm
132 kV	1700mm

The assembled insulating stick shall be of a length, which ensures that a minimum distance of 1500mm is achieved between the Limit Mark and the Hand Guard (multiple sections allowed).

The Hand Guard to base shall be >700mm.

7.2 Extension Stick

 Part No. 839-2 • Suits MV and HV sticks to extend the tip length	
Equipment Name	Hasting 839-2 which is 1,420mm in length that can be attached to the sunrise connector.
Make & Model	Hastings 839-2
Source(s)	Hastings/TEN Group
Application	Hasting 839-2 which is 1,420mm in length that can be attached to the sunrise connector.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment.</i> FSYD2023/7845 High Voltage AC Tester Fameca Tag 330
Limitations	

7.3 Round measuring telescopic stick

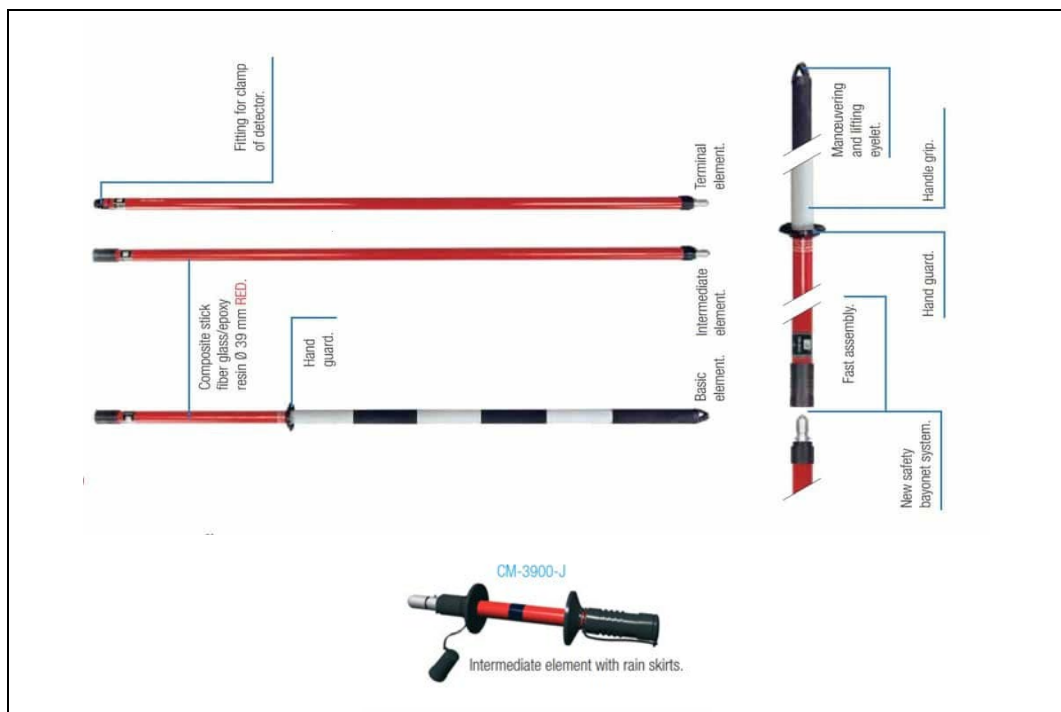
	
Equipment Name	Round Measuring Telescopic Stick with foam-filled tip section – M Series
Make & Model	Hastings TEL-O-POLE M - series
Source(s)	Hastings/TEN Group
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	–

7.4 Operating stick – dense foam filled

	
Equipment Name	Operating Stick – Dense Foam Filled
Make & Model	
Source(s)	TMAC
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	–

7.5 OHW/Rail connection insulated sticks

	
Equipment Name	OHW/Rail Connection Insulated Stick
Make & Model	CATU CM-4-20A, CM-4-20E modified to A-SPEC A842
Source(s)	CATU
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>A-SPEC A842</i> <i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	–

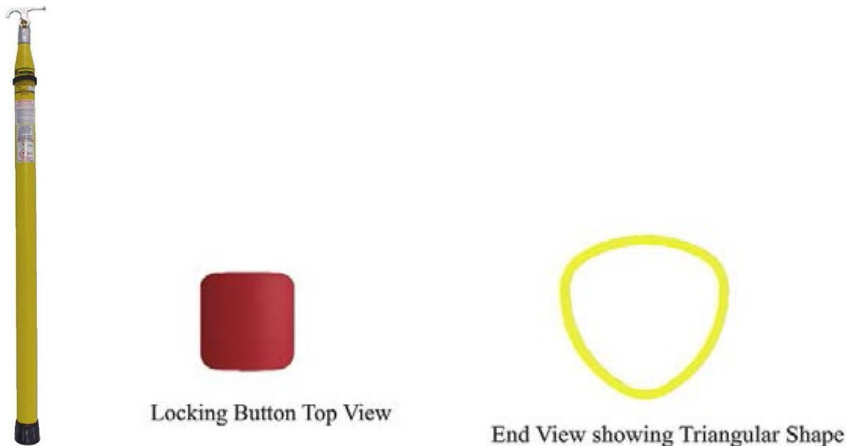


Equipment Name	OHW/Rail Connection Insulated Stick
Make & Model	CATU CM-46 range, Bayonet Head fitting (E), Rain Skirt
Source(s)	
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i> <i>FSYD2022/7637 1500V insulated stick catu-CM46 range</i>
Limitations	Rain Skirt must be fitted above the basic element when used in damp conditions.

7.6 1500 Volt DC insulated stick – foam filled

	
Equipment Name	Insulated Stick – Foam Filled
Make & Model	Various
Source(s)	Various
Application	Electrically insulated tools and equipment for use near or on/within LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	Insulated section to hand guard to be > 500mm.

7.7 1500 Volt DC operating and measuring telescopic sticks

	
Equipment Name	Triangular Operating and Measuring Telescopic Sticks with Foam-filled Top Section – HV and MV Series
Make & Model	Hastings TEL-O-POLE HV - series
Source(s)	Hastings/TEN Group
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	–

7.8 Live line rope insulator

	
Equipment Name	Live line rope accessory with composite insulator
Make & Model	
Source(s)	Cutting Head from Hastings FTG 453/17 (S/C: 001874239, EL015095) from W560 Clyde Warehouse (Distributed by DULHUNTY POWER (AUST) PTY LTD). Rope pulley arrangement assembled by Network Base personnel.
Application	Electrically insulated tools and equipment for use near or on/within LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i> Rope pull type cutter with composite insulator fitting No 453/17, drawing No EL0150595 installed within the rope 1.4 metres from the insulated tool accessory. NOTE: The operator is to ensure that the rope below the insulator is to remain outside the required SAD (0.5M for Authorised Persons)
Limitations	–

	
Equipment Name	Live line rope accessory with insulating fibre glass rod insulator
Make & Model	Rope pull type measuring device Hastings 546 Series with 12.7mm (1/2") thick 1.2 metre long rod fibreglass installed within the rope, in line with the main hot stick pole. There is to be a 500mm distance between the bottom of the insulator and the operator's hands and a marker placed in the rope as a visual aid.
Source(s)	Hastings/TEN Group (stick and fittings) Assembly rigged by network base personnel.
Application	Electrically insulated tools and equipment for use near or on/within of LIVE 1500 Volt equipment.
Documentation	<i>D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	NOTE: The operator is to ensure that the rope below the insulator is to remain outside the required SAD (0.5m for Authorised Persons). Persons operating this piece of equipment must be qualified to AES 15 and AES 16.

7.9 FAMECA Penta Pole Insulated Stick

 	
Equipment Name	FAMECA Penta Pole
Make & Model	FAMECA Penta Pole
Source(s)	4NRJ
Application	Electrically insulated stick for use with 4NRJ overhead wire thickness measuring equipment. Complies with IEC80825 for 25kVAC.
Documentation	D2015/47063 <i>Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment</i>
Limitations	For use with 4NRJ overhead wire thickness measuring equipment.

8 Assemblies and Kits

8.1 Live low-voltage rescue kit



Equipment Name	Live Low-voltage Rescue Kit, comprising of: • torch • emergency isolation tag • low voltage retrieval aid (insulated crook) • trauma dressing • rescue kit bag • fire blanket • insulated gloves • list of contents for kit.
Make & Model	NA
Source(s)	TMAC and other suppliers
Application	
Documentation	<i>SP D 79032 Live Low Voltage Rescue Kit</i> <i>D2013/80870 Rescue from Live Low Voltage - Including Rescue Kit Care)</i>
Limitations	–

8.2 Pole-top rescue kit

	
Equipment Name	Pole Top Rescue Kit
Make & Model	
Source(s)	Commercially available – e.g. TMAC, TEN Group, Balmoral Engineering, Safety Supply Solutions etc.
Application	
Documentation	<i>PR D 78109 Pole Top Rescue</i> SP D 79040 Pole Top Rescue Kits
Limitations	–Only to be used for rescue

8.3 Pole marker

	
Equipment Name	
Make & Model	Bay Products
Source(s)	Nick Bult Bay Products P: 08 8356 5555 F: 08 8356 5544 E: bayproducts@optusnet.com.au M: 0418 843 730
Application	
Documentation	PR D 78108 Pre-work Hazard Assessment for Work on Poles with Live Exposed Equipment
Limitations	–

8.4 Substation demarcation taping equipment

	
Equipment Name	Substation Electrically Safe Work Area Demarcation Taping Equipment
Make & Model	

Source(s)	Refer to TfNSW specification for supplier details.
Application	For substation use: tape, tape stands, warning sign holder, tape stand weights, entrance bollards, warning signs.
Documentation	TfNSW standard <i>T HR EL 15001 SP Substation Electrically Safe Work Area Demarcation Taping Equipment</i> <i>PR D 78506 Substation – Demarcation Taping</i>
Limitations	–

8.5 1500 Volt OHW Attached Climbing Kit Assembly

	
Equipment Name	1500 Volt OHW Attached Climbing Kit Assembly – 1500 Volt OHW Attached Climbing Kit Assembly – attached climbing ladder, ladder hook and attachment point assembly, attached climbing kit, rescue kit.
Make & Model	Branach Extension Ladder with Fall Control System
Source(s)	EP 15 10 00 03 SP 1500V OHW Attached Climbing Kit Assembly
Application	Climbing 1500 Volt DC structures and overhead wiring
Documentation	TfNSW standard <i>EP 15 10 00 03 SP 1500V OHW Attached Climbing Kit Assembly</i> <i>D2013/80532 Using 1500V Overhead Wiring Attached Climbing Ladder</i> <i>D2013/80533 Working from 1500V Overhead Wiring Attached Climbing Ladder</i>
Limitations	–

9 Reference documents

D2013/80532 Using 1500V Overhead Wiring Attached Climbing Ladder

D2013/80533 Working from 1500V Overhead Wiring Attached Climbing Ladder

D2013/80870 Rescue from Live Low Voltage - Including Rescue Kit Care)

D2015/47063 Use of Electrically Insulated Tools and Equipment On, Near or in the Vicinity of LIVE 1500V DC equipment

D2022/4477 Use of Approved High Voltage AC Contact Voltage Detectors – CATU CC775

D2022/4012 Hivotech 1500V DC OHW Tester application and functions

EP 15 00 00 01 SP High Voltage AC Voltage Detector (Nominal Voltage of 11kV - 66kV)

EP 15 10 00 03 SP 1500V OHW Attached Climbing Kit Assembly

PR D 78108 Pre-work Hazard Assessment for Work on Poles with Live Exposed Equipment

PR D 78109 Pole Top Rescue

PR D 78203 High Voltage Operating Procedure

PR D 78305 1500 Volt Operating Procedures

PR D 78306 1500 Volt DC Overhead Wiring Structure to Rail Voltage Test

PR D 78402 Work on the Low Voltage Distribution System

PR D 78506 Substation – Demarcation Taping

PR D 78701 Personnel Certifications – Electrical

SP E 79030 Voltage Detector for use on 1500V DC Overhead Wiring

SP D 79032 Live Low Voltage Rescue Kit

SP D 79033 Requirements for Portable Earthing Equipment for the High Voltage System

SP D 79045 Inspection and Care of Portable Rail Connecting Equipment for 1500 Volt Overhead Wiring

SP D 79047 Earthing High Voltage Equipment using Portable Earthing Equipment

T HR EL 15001 SP Substation Electrically Safe Work Area Demarcation Taping Equipment

IEC 61243-1 Live Working-Voltage Detectors Pt1