

**Engineering System Integrity
Electrical Network Safety Rules**

**Engineering Specification
Electrical Distribution Unit**

One Method of Safe Working

SP D 79042

**Description and Labelling of the
High Voltage Feeder System**

Version 1.0

Date in Force: 1 February 2022

Approved by: Associate Director
Electrical Distribution Unit
Engineering System Integrity

Authorised by: Engineering Technical
Publications Manager
System Integrity

Disclaimer

This document was prepared for use by persons in connection with works near or on/within the rail network electricity system operated by Sydney Trains. Sydney Trains makes no warranties, express or implied, that compliance with the contents of this document shall be sufficient to ensure safe systems or work or operation. It is the document user's sole responsibility to ensure that the copy of the document it is viewing is the current version of the document as in use by Sydney Trains. To the extent permitted by law, Sydney Trains excludes any and all liability for any loss or damage, however caused (including through negligence), which may be directly or indirectly suffered in connection with the use of this document.

Copyright

The information in this document is protected by copyright and no part of this document may be reproduced, altered, stored or transmitted by any person without the prior consent of Sydney Trains.

Document control

Version	Date	Author/ Prin. Eng.	Summary of change
1.0	1 February 2022	ENSR Project Team	First issue as Sydney Trains document. Rebranded from PR D 78200 V1.2. Reviewed as part of the ENSR Project.

Document history (previously PR D 78200)

Version	Date	Author/ Prin. Eng.	Summary of change
1.0	28 April 2015	Chris Leung	First issue as a Sydney Trains document, rebranded from previous RailCorp SMS-06-EN-0559 V1.2
1.1	2 July 2018	Chris Leung	Section 4. Control of the High Voltage Feeder Identification System updated from "System Control Engineer" to "Principal Engineer Power Systems"
1.2	19 February 2019	Nick Loveday	Updated PR D 78200 "Approved by" to Associate Director Electrical Distribution Unit

Table of Contents

1	Purpose and Scope	4
2	Definitions	4
3	High Voltage System Description	4
4	High Voltage Feeder Labelling	5
4.1	General.....	5
4.2	Feeder Labelling	5
4.3	Section Numbers.....	5
4.4	Cables in Parallel	6
5	Control of the High Voltage Feeder Identification System	7

1 Purpose and Scope

To describe the arrangement and labelling conventions applicable to Transport Asset Holding Entity of New South Wales (TAHE) High Voltage (HV) AC feeder system.

This specification does not apply to HV distribution equipment, the 1500 Volt DC traction system, the Low Voltage (LV) distribution system, LV installations, or signalling systems.

2 Definitions

Refer to the **Electrical Safety Definitions** page available on the **RailSafe** site.

3 High Voltage System Description

TAHE is a state owned Corporation that holds rail property assets, rolling stock and rail infrastructure in NSW. Sydney Trains, NSW Trains and others operate and maintain the TAHE Assets.

Electric power for Sydney Trains' operations is supplied from other Network Operators' systems at a number of supply points at voltages of 11kV to 132kV.

Sydney Trains distributes this power via its own HV AC aerial lines and underground cables to a number of substations. TAHE HV feeders are located both on and off the rail corridor. In some cases TAHE power poles also support HV and LV aerial lines and other equipment belonging to other network operators. Such situations are usually noted on the reticulation diagrams. Similarly, in some cases TAHE underground cables are sometimes buried with cables belonging to other network operators.

The substations contain equipment for voltage transformation, switching, overload and fault protection, voltage regulation and rectification for supply to the 1500 Volt DC traction system.

In addition to power for electric traction, power is supplied for signalling and other TAHE installations and also for TAHE's retail electricity customers including railway stations, offices, workshops and depots.

4 High Voltage Feeder Labelling

4.1 General

A HV feeder is the collective name given to the entire HV aerial line or cable that generally commences and finishes at a substation. The HV feeder extends out of a substation, and runs to the next substation. The HV feeder run may pass through one or more substations along the way but the switches and busbars inside these substations are not part of the HV feeder. The HV feeder usually commences and finishes on the feeder side of the respective substation disconnecter e.g. air break switch or ACCB.

The TAHE HV feeder labelling convention considers; voltage levels, sections and arrangement of cables, i.e. cables in parallel. The labelling conventions are described in the following sections.

4.2 Feeder Labelling

HV aerial lines and cable feeders are numbered in accordance with the voltage of the feeder. The numbers used are:

11kV feeders	500 to 699
33kV feeders	700 to 799, and 7A1 to 7Z9
66kV feeders	800 to 899
132kV feeder	286 (only 1 from Ausgrid (Engadine) SS to TAHE's Heathcote SS)

NOTE

In order to prevent confusion:

- The following identifiers are generally NOT assigned:**
 - the letter “I” as it can be confused with the number “1”
 - the letter “O” as it can be confused with the number the “0”, and
 - the letter “S” as it can be confused with the number “5”.
- A check to ensure that the proposed identifier would not be confused with other identifiers of other TAHE or network distributor feeders at the same or adjacent locations is completed.**

4.3 Section Numbers

The HV feeder may be divided into numbered electrical sections.

Where a HV feeder is sectioned by disconnectors, typically at substations, the sections are identified by adding a stroke and a number to the feeder number, for example, 11kV Feeder 644/1, 644/2, etc. up to 644/n where n is the number of sections. Figure 1 shows a typical feeder broken into sections.

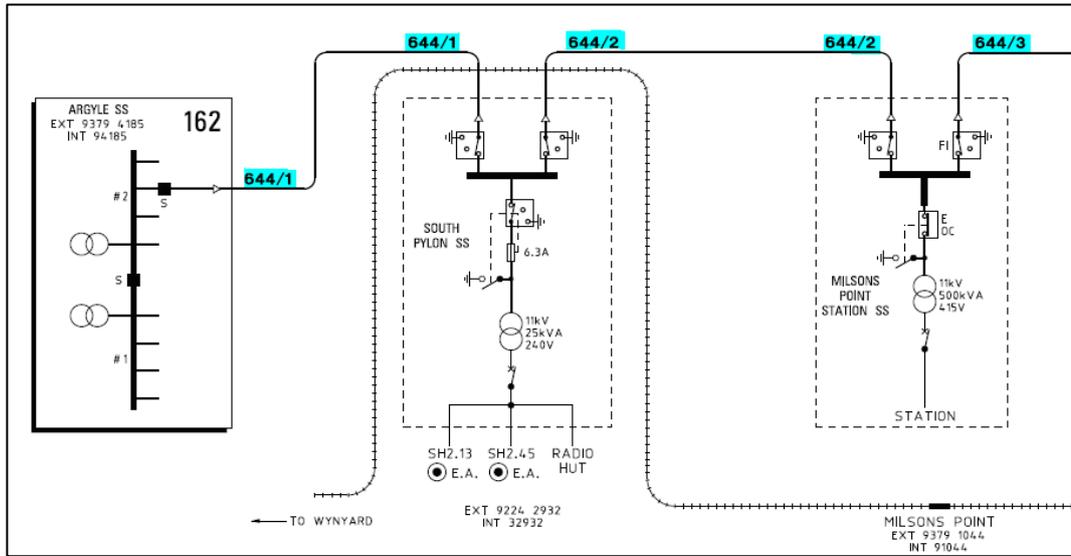


Figure 1: A feeder run between substations is divided into sections

4.4 Cables in Parallel

Where HV cable feeders comprise two cables in parallel, the cables are identified by adding a letter to the feeder number, e.g. the cables of 11kV feeder 533 are 533A and 533B and for 33kV feeder 766 are 766L and 766R. Refer to Figure 2 and Figure 3 below.

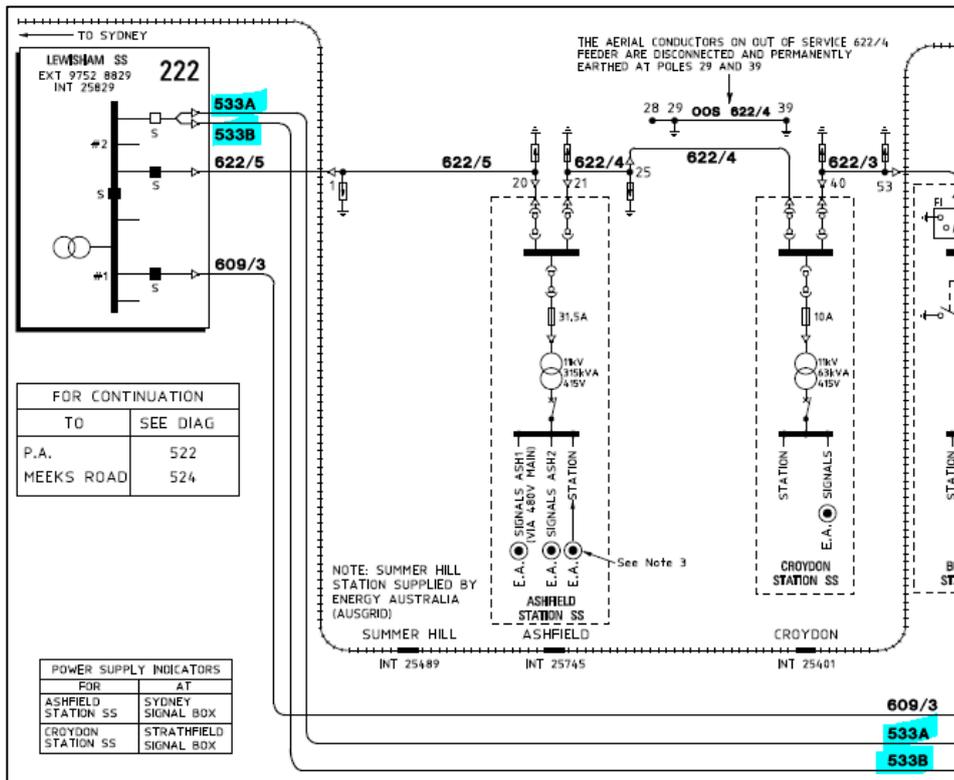


Figure 2: An example of identification of cable feeders in parallel

